



CENTRAL MINE PLANNING & DESIGN INSTITUTE LIMITED
(A Subsidiary of Coal India Ltd.)
REGIONAL INSTITUTE-V,
SEEPAT ROAD,
BILASPUR – 495006

TENDER DOCUMENT(Part-I)

FOR

Electrical works (two points) power supply from 15 kVA DG set to hutments at Singhpur Exploration camp, Shahdol (MP) of CMPDI, RI-V Bilaspur.

CENTRAL MINE PLANNING & DESIGN INSTITUTE LTD
(A Subsidiary of Coal India Ltd)
Regional Institute – V
Seepat Road, Bilaspur – 495006

Name of work : Electrical works (two points) power supply from 15 kVA DG set to hutments at Singhpur Exploration camp, Shahdol (MP) of CMPDI, RI-V Bilaspur.

Place of work : CMPDI, Exploration camp at Singhpur, Shahdol(MP)

Tender Notice No. & Date : CMPDI/RV/E&M/ Elect. Wiring/ Singhpur/2015/ 3415 Dated 02.11.2015

Sale of Tender Document : From 04.11.2015 (4.00 PM) to 19.11.2015 till 1.00 P.M

Date and time of submission of tender : 19.11.2015 up to 3.00 PM

Date and time of opening of tender : 19.11.2015 at 3.30 PM

Issued to :

Signature of Issuing Authority



cmpdi
A Mini Ratna
and ISO 9001
Company

सेन्ट्रल मार्ईन प्लानिंग एण्ड डिजाइन इन्स्टीट्यूट लि.
कोल इंडिया लिमिटेड की अनुषंगी कंपनी/भारत सरकार का एक लोक उपक्रम
क्षेत्रीय संस्थान-5, एसईसीएल काम्पलेक्स, सीपत रोड, बिलासपुर 495006 (छ.ग)

Central Mine Planning & Design Institute Limited
A Subsidiary of Coal India Ltd/ A Govt. of India Public sector Undertaking
CIN:U14292JH1975GO1001223
RI-V, SECL Complex, Seepat Road, Bilaspur (CG)- 495006
ई-मेल / e-mail: ri5@cmpdi.co.in / cmpdi5@rediffmail.com



Tel: 07752-246481-492
Fax: 07752-246481

CMPDI/RV/E&M/ Elect. Wiring/Singhpur/2015/ 3415

Date : 02.11. 2015

NOTICE INVITING TENDER

Sealed tenders on percentage rate basis are invited in two parts system, on behalf of the Regional Director, CMPDI Ltd., RI-V, Bilaspur, for taking up the following work:

Sl.No.	Name of work	Estimated cost (Rs.)	EMD (Rs.)	Application fee for tender document	Period of completion
1.	Electrical works (two points) power supply from 15 kVA DG set to hutments at Singhpur Exploration camp, Shahdol (MP) of CMPDI, RI-V Bilaspur.	4,55,089.00	4600.00	Rs. 250/- (non refundable)	2 months/ 60days

1. ISSUE OF TENDER DOCUMENTS :

Tender documents will be issued individually on requisition in writing from the intending tenderers or their accredited representatives. Tender documents can be obtained from the office of the General Manager (E&M)/HOD(E&M), RI-V, CMPDI , Bilaspur, on payment of the prescribed application fee during working hours on any working day as per the dates mentioned below :

(i) Begins on : 04.11. 2015
(ii) Closes on : 19.11. 2015 till 1.00 PM

Application fee should be paid in cash with the cashier RI-V, CMPDIL, Bilaspur, on all working days from 11 AM to 4.00 PM from Monday to Friday and from 11.00AM to 12.00 Noon on Saturday and cash receipt obtained should be produced for obtaining tender document. from the office of the General Manager (E&M)/HOD(E&M), RI-V, CMPDI , Bilaspur, Alternatively, Bank Draft drawn in favour of CMPDI,RI-V.Bilaspur, from any scheduled bank payable at Bilaspur, will also be accepted as cost of tender documents.

Sale of Tender Document : From 04.11.2015(till 4.00 PM) to 19.11. 2015 till 1 .00 P.M

Date and time of submission of tender : 19.11.2015 up to 3.00 PM

Date and time of opening of tender : 19.11.2015 at 3.30 PM

Alternatively

The complete tender document is also available on our web site www.cmpdi.co.in and can be downloaded during the period of sale of tenders. However, the bidders who will download the tender documents from the website of the company, will be required to pay the cost of tender documents by Bank Draft in favor of CMPDI,RI-V.Bilaspur, as per NIT at the time of submission of tenders.

The company shall not be responsible for any delay/difficulties/inaccessibility of the downloading facility for any reason whatsoever.

2. SUBMISSION OF TENDERS

(i) Date and Time for submission of tender : 19.11.2015 upto 3.00 PM
(ii) Location/Place for submission of tenders : In the office of the General Manager (E&M)/HOD(E&M), RI-V, CMPDIL, Bilaspur

The tender will contain the following :-

The Earnest Money Deposit is to be submitted in a separate Envelope altogether; superscribing “Earnest Money Deposit”, and not inside the envelope containing Part-I .

Part-1 : In separate envelope, Part-I of the tender document as issued to the tenderer, authenticated papers of credentials as per the eligibility criteria in the N.I.T., technical specifications, if any. All the credentials/certificates related to technical qualifications should be duly attested/by the agency.

Part-2 : In separate envelope, Part-II of the tender document (Price bid) as issued to the tenderer, with all the pages

signed by the tenderer. Rates should be quoted in figures and words both. Over writing and cutting in rates should be avoided. Cutting or over writing if unavoidable should be duly signed by the bidder.

The bidders, who will download the tender documents from the website of the company, will be required to pay the cost of tender documents (Application Fee) by Bank Draft as per NIT at the time of submission of tenders.

The bidders will be required to submit an undertaking that they will accept the tender documents as available in the website and their tender shall be rejected if any tampering in the tender document is found to be done at the time of opening of tender.

The Bank draft towards the cost of tender document (Application fee) and the undertaking of the tenderer as explained in the earlier para and given in Tender Document (Part-I) shall be submitted in a separate envelope marked "Cost of Tender documents and the undertaking" and not with Part-I/EMD.

In case of any discrepancy between the tender document downloaded from the web site and the master copy available in the office, the latter shall prevail and will be binding on the tenderers. No. claim on this account will be entertained.

The Part-I & Part-II should also be put into separate sealed envelopes superscribed as such. Thereafter all the three envelopes (four envelopes in case of bidders using downloaded bid document) should be submitted in a sealed envelope with appropriate superscription.

Each page of the tender document should be signed by the tenderer. This will not contain any alternative items or suggestions, comments or conditions. Late tenders/incomplete tenders/telegraph tenders, tenders received through Post/courier services or tenders received after due date and time of tender submission shall not be accepted.

Tenders not submitted in the manner as stated above shall be rejected out rightly.

3. OPENING OF TENDERS

- i) Place : In the office of the General Manager(E&M/HOD(E&M)), RI-V, CMPDIL, Seepat Road , Bilaspur-495006, in presence of the attending tenderers or their authorized representatives.
- ii) Part-I : On 19.11.2015 at 3.30 PM.
- iii) Part-II : To be opened subsequently only of eligible contractors fulfilling the eligibility criteria as per this NIT (Clause No.4) and who submit the tenders in the manner prescribed in clause-2. The date and time of opening will be intimated to the eligible tenderers before opening of Part-II.

4. THE ELIGIBILITY CRITERIA FOR THE WORK IS AS FOLLOWS :

To qualify for opening of price bid, the tenderer must submit the following documents along with **Tender Document Part I** :-

- a) Proof of having in his own name as a prime contractor, experience of having successfully executed similar works in any year during last seven years ending 31.03.2015 of values as indicated below :-

(Similar nature of works means indoor electrification work/ electrification of a building or a complex and outdoor cable laying of a building or a complex in support of which the tenderer must submit the copy of work order & Work completion certificate received from Govt.deptts / PSUs along with Part I of Tender Document).

- (i) three similar works each of value not less than 40% of estimated Amount, i.e, Rs. 1,82,036/-
Or
- (ii) two similar works each of value not less than 50% of estimated Amount, i.e, Rs. 2,27,545/- .
Or
- (iii) a single similar work of value not less than 80% of estimated Amount, i.e, Rs. 3,64,072/- .

- b) Average annual financial turnover during last three years ending 31st March' 2015 should be at least 30% of estimated Amount, i.e, Rs.1,36,527/- .
- c) TIN /VAT no..
- d) Photocopy of PAN card.
- e) The tenderer must possess a valid electrical contractor's license i.e. 'A', 'B', 'B-1' or 'C' issued by competent licensing authority. A copy of the license should accompany the offer.
- f) Tenderer should quote their rates excluding the impact of service tax.
- g) The intending tenderer will have to submit an affidavit as per sample format given of the NIT(tender document) as a declaration in support of authenticity of the credentials/certificates submitted by him/them.

Incomplete submission of supporting documents with the tender including wrong declarations & certificates will summarily lead to rejection of tender.

5. **EARNEST MONEY DEPOSIT (EMD)**

Earnest money is to be deposited by the tenderer as in the form of Banker's Cheque/Demand Draft drawn in favour of CMPDI, RI-V, Bilaspur, on any Scheduled Bank payable at Bilaspur. No tender shall be considered unless accompanied by the requisite earnest money. Shall be put in separate envelope.

6. Mere issuance of tender documents will not make the tenderers eligible for the work. The tenderer should satisfy himself that he qualifies for the work as per eligibility criteria given in this tender notice. CMPDIL reserves its right to reject any or all tenders without assigning any reason whatsoever.

महा-प्रबन्धक/विभागाध्यक्ष (ई. & एम.)

Copy to :

- 1. GM(E&M), CMPDI, HQ, Ranchi.
- 2. HOD(E&M), CMPDIL, RI-I, II, III, IV, VI, VII
- 3. GM(E&M), SECL, HQ, Bilaspur
- 4. HOD(Finance), RI-V, CMPDI, Bilaspur
- 5. Web site of CMPDI Ltd. www.cmpdi.co.in
- 6. All Notice Boards in RI-V, Bilaspur.

} With a request to
Display in
Notice boards

DETAILED TENDER NOTICE

1. Sealed tenders in prescribed forms and parts with the name of works superscribed as “**Electrical works (two points) power supply from 15 KVA DG set to hutments at Singhpur Exploration camp, Shahdol (MP) of CMPDI, RI-V Bilaspur.**” **NIT NO.** CMPDI/RV/E&M/ Elect. Wiring/ Singhpur/2015/ 3415 Dated 02.11.2015 on each of the envelopes are invited from bonafide and experienced electrical contractors and will be received at the office HOD (E&M), CMPDI Ltd., CMPDI RI-V, Bilaspur, upto 3.00 PM on **19.11.2015**. All tenders will be opened at 3.30 PM on **19.11.2015** in the presence of the attending tenderers or their authorized representatives who wish to be present. In case where the tender is in two parts, only Part-I, will be opened on the above day and time.

2(a) Tenders should be submitted in the prescribed form in time. These forms together with the proposed contract document including specifications and tender drawings (if available) may be obtained from the above office during normal working hours on payment of Rs.250/- (non-refundable) (Rupees Two hundred fifty only) as Application fee for each set. The payment may be made either in cash or by Bank Draft drawn in favour of CMPDI, Bilaspur on any Nationalised Bank payable at Bilaspur. General specification and description of work is enclosed with the tender document.

2(b) Any Bids received after the deadline prescribed at Clause-1 above due to any reasons whatsoever will not be accepted.

In the event of the specified date for the submission of bids being declared a holiday by the employer, the bids will be received upto the appointed time on the next working day.

2(c) Part-I thus submitted shall consist of the following:

a) Proof of having in his own name as a prime contractor, experience of having successfully executed similar works in any year during last seven years ending 31.03.2015 of values as indicated below :-

(Similar nature of works means indoor electrification work/ electrification of a building or a complex and outdoor cable laying of a building or a complex in support of which the tenderer must submit the copy of work order & Work completion certificate received from Govt.deptts / PSUs along with Part I of Tender Document).

(i) three similar works each of value not less than 40% of estimated Amount, i.e, Rs. 1,82,036/- Or
(ii) two similar works each of value not less than 50% of estimated Amount, i.e, Rs. 2,27,545 /- Or
(iii) a single similar work of value not less than 80% of estimated Amount, i.e, Rs. 3,64,072/-

b) Average annual financial turnover during last three years ending 31st March' 2015 should be at least 30% of estimated Amount, i.e, Rs.1,36,527/- .

c) TIN /VAT no..

d) Photocopy of PAN card.

e) The tenderer must possess a valid electrical contractor's license i.e. 'A', 'B', 'B-1' or 'C' issued by competent licensing authority. A copy of the license should accompany the offer.

f) Full name and address of the tenderer shall be written on the bottom left hand corner of the sealed cover.

g) The intending tenderer will have to submit an affidavit as per sample format given at page no.16 of the NIT(tender document) as a declaration in support of authenticity of the credentials/certificates submitted by him/them.

2(d) The tender document in which the tender is submitted by the tenderer shall become the property of the Company and the Company shall have no obligation to return the same to the tenderer.

2(e) The tender shall be submitted in two parts as indicated in the notice inviting tenders.

Part-I shall consist of any deviations from terms and conditions of the tender and additional terms and conditions and if asked for, technical bid and credentials (documentary evidence in support of Eligibility criteria and bid assessment duly authenticated by the bidder) and the original tender document issued to the bidder duly signed by authorised signatory of the bidder on all pages as proof of accepting the conditions of contract (excluding the price bid)

Part-II shall consist of priced bill of quantities duly filling in rates, amounts etc.

The earnest money deposit is to be submitted in a separate envelope altogether, super scribing “**earnest money deposit**”; and not inside the envelope containing part-I or part-II of the bid.

The part-I and part-II should also be put into separate sealed envelopes super scribed as such. Thereafter all the three envelopes should be submitted in a sealed envelope with appropriate superscription.

2(f) Each bidder shall submit only one bid for one package. A bidder who submits or participates in more than one bid (other than as sub-contractor or in case of alternatives that have been permitted or requested) will cause all the proposals with the bidders' participation to be disqualified.

3. Earnest Money/Bid Security @ 1% of the estimated cost (rounded off to nearest hundred rupees) subject to maximum of Rs.50 lakhs, is to be deposited, in the form of Banker's cheque/demand drafts drawn in favour of CMPDI Ltd. on any scheduled Bank payable at its branch at Bilaspur. The earnest money may be deposited in cash. Cash receipt is to be

submitted in a separate envelope along with the tender. Earnest Money/Bid security of the unsuccessful bidder shall be refunded as promptly as possible after opening of Price Bid and finalisation of the tender and shall bear no interest.

4. No tender shall be considered unless accompanied by the said earnest money.

5. The earnest money will be retained in the case of successful tenderer and refunded to the unsuccessful tenderer in due course and will not carry any interest. The earnest money deposited by the successful tenderer will be dealt with as provided elsewhere in the tender documents.

6. Every tenderer is expected, before quoting his rates, to go through the requirements of materials/workmanship under specification/requirements and conditions of contract and to inspect the site area of the proposed work.

The rates shall be written both in words and figures and the unit in the words and the amount against each item totalled. In the event of any discrepancy between the description in words and figures, the description in words will prevail. The rates for the work should be inclusive of all incidentals, overheads, all taxes, Octroi's, duties, leads, lifts, carriage, tools & plant etc. as required for execution and completion of the work. It shall be deemed that the tenderer has visited the site/area and got fully acquainted with the working conditions and other prevalent conditions and fluctuations thereto whether they actually visited the site/area or not and have taken all the above factors into account while quoting his rates.

7(a) Corrections where unavoidable, shall be made by crossing out and rewriting duly authenticated with full signature and date by the tenderer. Erasing or over-writing in the tender documents may disqualify the tender.

8 Cost of Bidding : The bidder shall bear all costs associated with the preparation and submission of his bid and the CMPDI employer will in no case be responsible and liable for those cost.

9. The tenderer shall closely study all specification in detail, which govern the rates for which he is tendering.

10. The work should be completed within 2 months from expiry of ten(10) days from the issue of letter of acceptance of tender / work order or handing over the site or handing over reasonable number of working drawings to the contractor or the period of mobilisation allowed in the work order for starting the work in special circumstances, whichever is latest.

11. On completion of the work all rubbish, debris, brick bats etc. shall be removed by the contractor(s) at his/their own expense and the site cleaned and handed over to the company and he/they shall intimate officially of having completed the work as per contract.

12. The Company does not bind itself to accept the lowest tender and reserves the right to reject any or all the tenders without assigning any reasons whatsoever and to split up the work between two or more tenderers or accept the tender in part and not in entirety.

13. The tenderer(s) should also state what technical/ supervisory personnel he/they would be employing for supervising the work.

14(a). Full information should be given by the tenderer in respect of following

i) If an individual : Full name.
Postal Address.
Place of Business.

ii) If proprietary firm : Name of the Proprietor.
Full postal address of
Firm/Proprietors.

iii) If a partnership firm : Full name of partners.
Full postal addresses of the registered office
of firm & the partners.
Registered partnership Deed.

iv) In case of Company : Date and place of registration.
Memorandum & Articles of Association .
Name all the Directors.
Full postal address of the registered office &
all the Directors.

v) Joint Venture : Two or three companies/contractors participating in the tender as Joint Venture
should submit Firm-wise participation details, Banker's name, execution of
work with details of contribution of each and all other relevant details

Notes : Joint Ventures must comply the following requirements :

i) Following are the minimum qualification requirements for joint ventures :

a) The lead partner shall meet not less than 40% of all the qualifying criteria stated in the bid document

b) The other partners shall meet not less than 30% of all the qualifying criteria stated in the bid document.

- ii) The formation of joint venture or change in the joint venture character/partners after submission of the bid and any change in the bidding regarding joint venture will not be permitted.
- iii) Any bid shall be signed so as to legally bind all partners jointly and severally and any bid shall be submitted with a copy of the Joint Venture Agreement (JV Agreement) providing the joint and several liabilities with respect to the contract
- iv) The pre-qualification of a joint venture does not necessarily pre-qualify any of its partners individually or as a partner in any other joint venture or association. In case of dissolution of a joint venture, each one of the constituent firms may pre-qualify if they meet all the pre-qualification requirements, subject to written approval of the employer.
- v) The bid submission must include documentary evidence to the relationship between joint venture partners in the form of JV Agreement to legally bind all partners jointly and severally for the proposed agreement which should set out the principles for the constitution, operation, responsibilities regarding work and financial arrangements, participation (percentage share in the total) and liabilities (joint and several) in respect of each and all of the firms in the joint venture. Such JV Agreement must evidence the commitment of the parties to bid for the facilities applied for (if pre-qualified) and to execute the contract for the facilities if their bid is successful.
- vi) One of the partners responsible for performing a key component of the contract shall be designated as Lead Partner. This authorization shall be evidenced by submitting with the bid a Power of Attorney signed by legally authorized signatories of all the partners.
- vii) The JV Agreement must provide that the Lead Partner shall be authorized to incur liabilities and receive instructions for and on behalf of any and all partners of the Joint Venture and the entire execution of the contract shall be done with active participation of the Lead Partner.
- viii) The contract agreement should be signed jointly by each Joint Venture Partners
- ix) An entity can be a partner in only one Joint Venture. Bid submitted by Joint Ventures including the same entity as partner will be rejected.

14(b) Change in constitution of the Contracting Agency :

Prior approval in writing of the company shall be obtained before any change is made in the constitution of the contracting agency, otherwise it will be treated as a breach of contract.

15. Canvassing in connection with the tenders in any shape or form is strictly prohibited and tenders submitted by such tenderers who resort to canvassing shall be liable for rejection.

16 If a tenderer deliberately provides wrong information or submits false credentials in support of his qualifications, the Company reserves the right to terminate/rescind the contract and forfeit the EMD and other dues of the contractor and to take any other action as may be deemed fit.

17 An intending tenderer, after obtaining tender documents on payment of Application Fee, having doubts as to the meaning of any part of the tender documents may submit to the official inviting tender a written request for interpretation or clarification thereof. Any interpretation or clarification of the tender documents by formal addendums if issued by the official inviting tender, shall be final and valid and binding on the company and the tenderers.

18 On receipt of letter for acceptance of the tender issued by the Company, the successful tenderer shall execute/accept contract agreement/work order in the company's prescribed form for the due fulfilment of the contract. Failure to enter into the required contract/accept the work order issued by the company within the specified period in the work order shall entail cancellation of letter of acceptance of tender/work order and forfeiture of the earnest money. The written contract/work order to be entered into between the contractor and the company shall be the foundation of the rights of both the parties and the contract shall not be deemed to be executed until the contract/ work order is signed/accepted by both the parties i.e. Contractor and the Company.

19 The validity period of the tenders shall be 4 (four) months from the date of opening of price bid or revised price bid, if any.

The tenderer shall not, during the said period or within the period extended by mutual consent, revoke or cancel his tender or alter the tender or any terms/condition thereof without consent in writing of the company.

In case the tenderer violates to abide by this, the Company will be entitled to forfeit the Earnest Money and reject the tender.

20. This detailed Tender Notice shall be deemed to be part of the Contract Agreement/Work Order.

21. No subletting of work as a whole by the contractor is permissible.

23. In case the contractor enters into any litigation such action should have to be taken in a court of law with jurisdiction over the place where the subject work is to be executed.

CENTRAL MINE PLANNING & DESIGN INSTITUTE LTD
REGIONAL INSTITUTE-V
Seepat Road , Bilaspur 495006

INSTRUCTIONS TO THE BIDDERS

1. %Rate above/ below or at par the Deptt. Estimate shall be written in words & figures (both).
2. As far as possible no over writing & cutting shall be made.
3. Cutting or over writing, if any, shall be duly signed by the bidder.
4. All pages of the quotation/tender shall be duly signed.
5. Conditional quotation/tender is liable to rejection at the discretion of CMPDIL.
6. The validity period of the quotation/tender shall be for 120 (One hundred twenty) days from the date of opening as stipulated in the notice of tender.
7. Quotationers/ tenderers are requested to visit the site of work to acquaint themselves about the location of work site, type of existing structure where work is to be carried out, etc. before quoting the rates/submission of quotation/tender.
8. The contractor must supply and erect the materials/ work according to the specification laid in the tender document however at all any ambiguity arises, then help of specification laid by state govt. PWD(ELECTRICAL) SOR 2010 & CPWD(ELECTRICAL) DSR 2013 shall be taken to reach final decision.

Signature of Contractor

Name & Address

Date :

TECHNICAL SPECIFICATIONS / SCOPE OF WORK

1.0 GENERAL :

1.1 CMPDI Ltd, Regional Institute –V, Bilaspur is having its Exploration camp hutments located at Singhpur, Shahdol in MP. There are 77 hutments including office . The office and hutments is receiving power from MPEB. The present work includes supplying and installation of MCB's, DB's, switch boards, new change over switch , MCCB , laying of power cables etc., for providing limited (two points- Light & Fan) emergency power supply to the Hutments and Office from existing15 KVA DG set.

Scope of Work :

The scope of this tender package is briefly as under :

- i) Supplying and laying a new PVC / XLPE Steel armoured, aluminium conductor cable of size **4 core x 25 sq.mm / 4 core x 16 sq.mm** from existing 15 KVA DG set for hutments. The cables for supplying power to blocks of each hutments shall be run and terminated in the junction/terminal box at the same block. The cable shall be terminated in the box in such a manner so that ingress of water (rain) can be avoided. The cable termination for cable sizes 16 sqmm /25sqmm shall be inside each vertical section. All the cable entries shall be from bottom.
- ii) Supplying and installation of DBs on the wall of each block of hutments and Supplying and drawing of 4 sqmm PVC insulated flexible copper wire from the junction/ terminal boxes to the incoming of DBs.
- iii) Supplying and installation of MCB and piano type Two way switch fixed on separate wooden board by the side of existing switch board in the Drawing room of each hutment. (as shown in the Drawing no.1)
- iv) Supplying and Drawing of 1.5 sqmm PVC insulated flexible copper wire through PVC conduit wiring from the DB of each block of hutments to the MCBs in the Drawing room of each hutment.
- v) Separate Neutral wiring from the DG set to the hutments is not envisaged. The existing Neutral at the mains shall be routed through the change over switch to be installed at DG set so that the Neutral circuit is connected to DG set neutral on change over to D.G. set supply.(refer drawing no.2)

vi) Fabrication, Supply, installation, testing and commissioning of cubicle type compartmentalized floor mounted power cum control panel board of made out of not less than 2 mm thick CRCA MS sheet with suitable size compartments for bus bars, switch gears and necessary cutouts as per specifications including powder coating painting but without busbars, switchgears and other accessories etc. complete as required. There shall also be pad locking arrangement for the door to prevent unauthorized access. The terminals of the fixed type MCCBs shall be shrouded to prevent access to the live parts. The board shall have a display of danger notice . The panel board shall be suitably designed and fabricated not only to house 4 pole change over switch and MCCB/MCB for routing the DG power supply to hutments but also to house the existing change over switch to pump , starter panel etc.

MATERIALS:


All materials and fittings used in the electrical installation shall be of the best quality obtainable and of approved manufacture and as per enclosed vendor list and shall conform to the latest Indian Standard Specifications. Where Indian Standard Specifications are not available, relevant British Standards shall become applicable.


WORKMANSHIP:

Good workmanship and neat appearance are the pre-requisites for compliance with the various sections of these specifications. The work shall be carried out under direct supervision of a person holding certificate of Electrical supervisorship issued by the statutory authority of state Govt. The relevant I.S.I. Code of practice shall be followed wherever applicable.

DRAWINGS:

Two copies of wiring diagram and layout plans, the bill of quantities and specifications shall be furnished by the Engineer In charge to the Contractor for his own use until the completion of the contract which shall be accessible at all reasonable times to the Engineer In charge or their representatives. The tender drawings indicate only the general scheme of requirements. Exact position of all points, controls, switch etc. shall be got approved by the Engineer In charge before the commencement of the work. Wherever required detailed drawings shall be prepared and got approved. On completion of the work, complete drawings shall be prepared and two copies of the same submitted to the employer through the Engineer In charge. The completion drawings shall indicate clearly, the main distribution power board, the runs of various mains and sub-mains, position of points and their controls. All circuits shall be clearly indicated and numbered in the wiring diagrams and all points shall be given the same number as the circuit to which they are electrically connected.

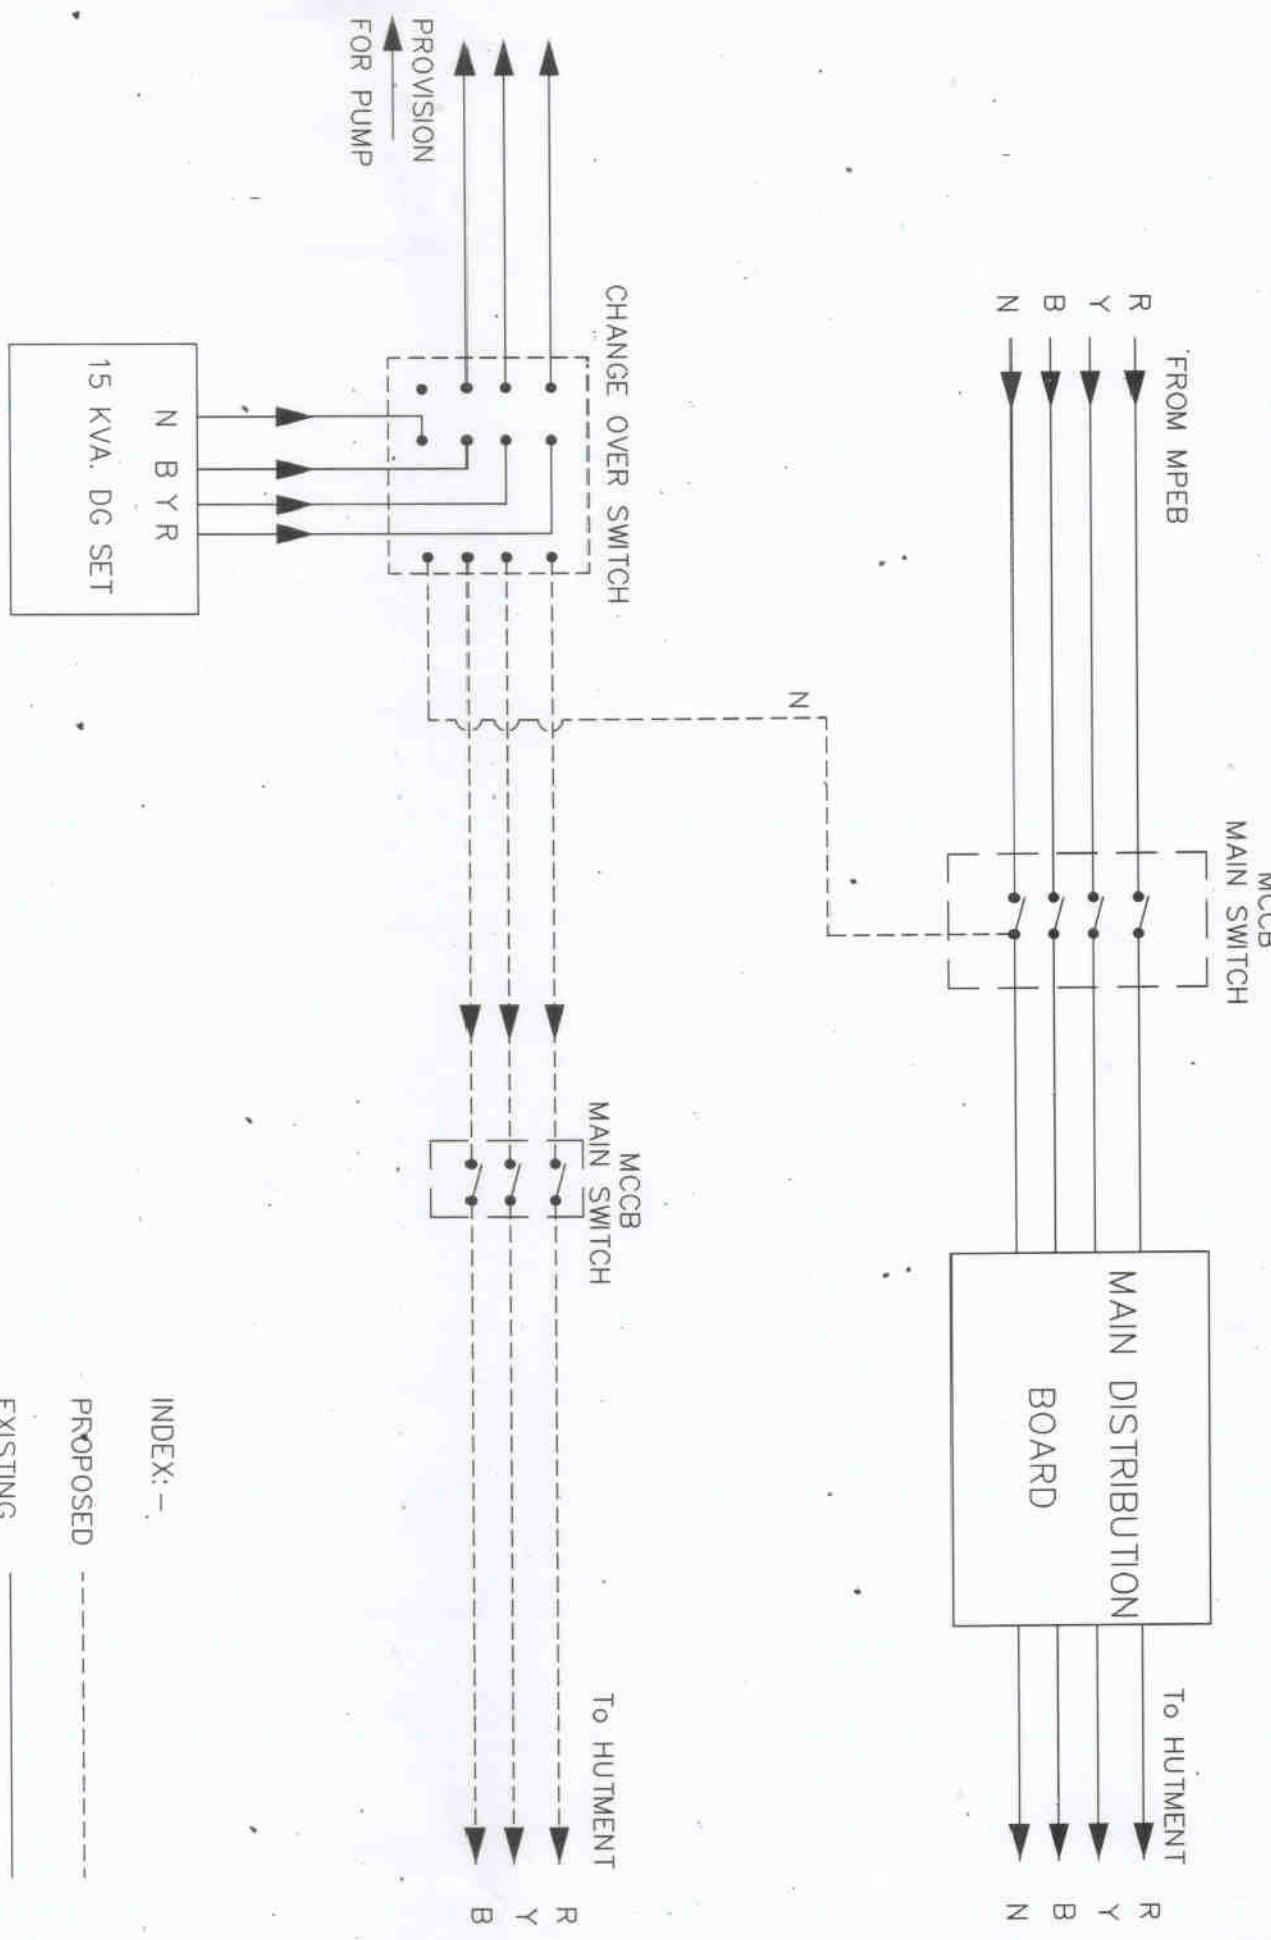

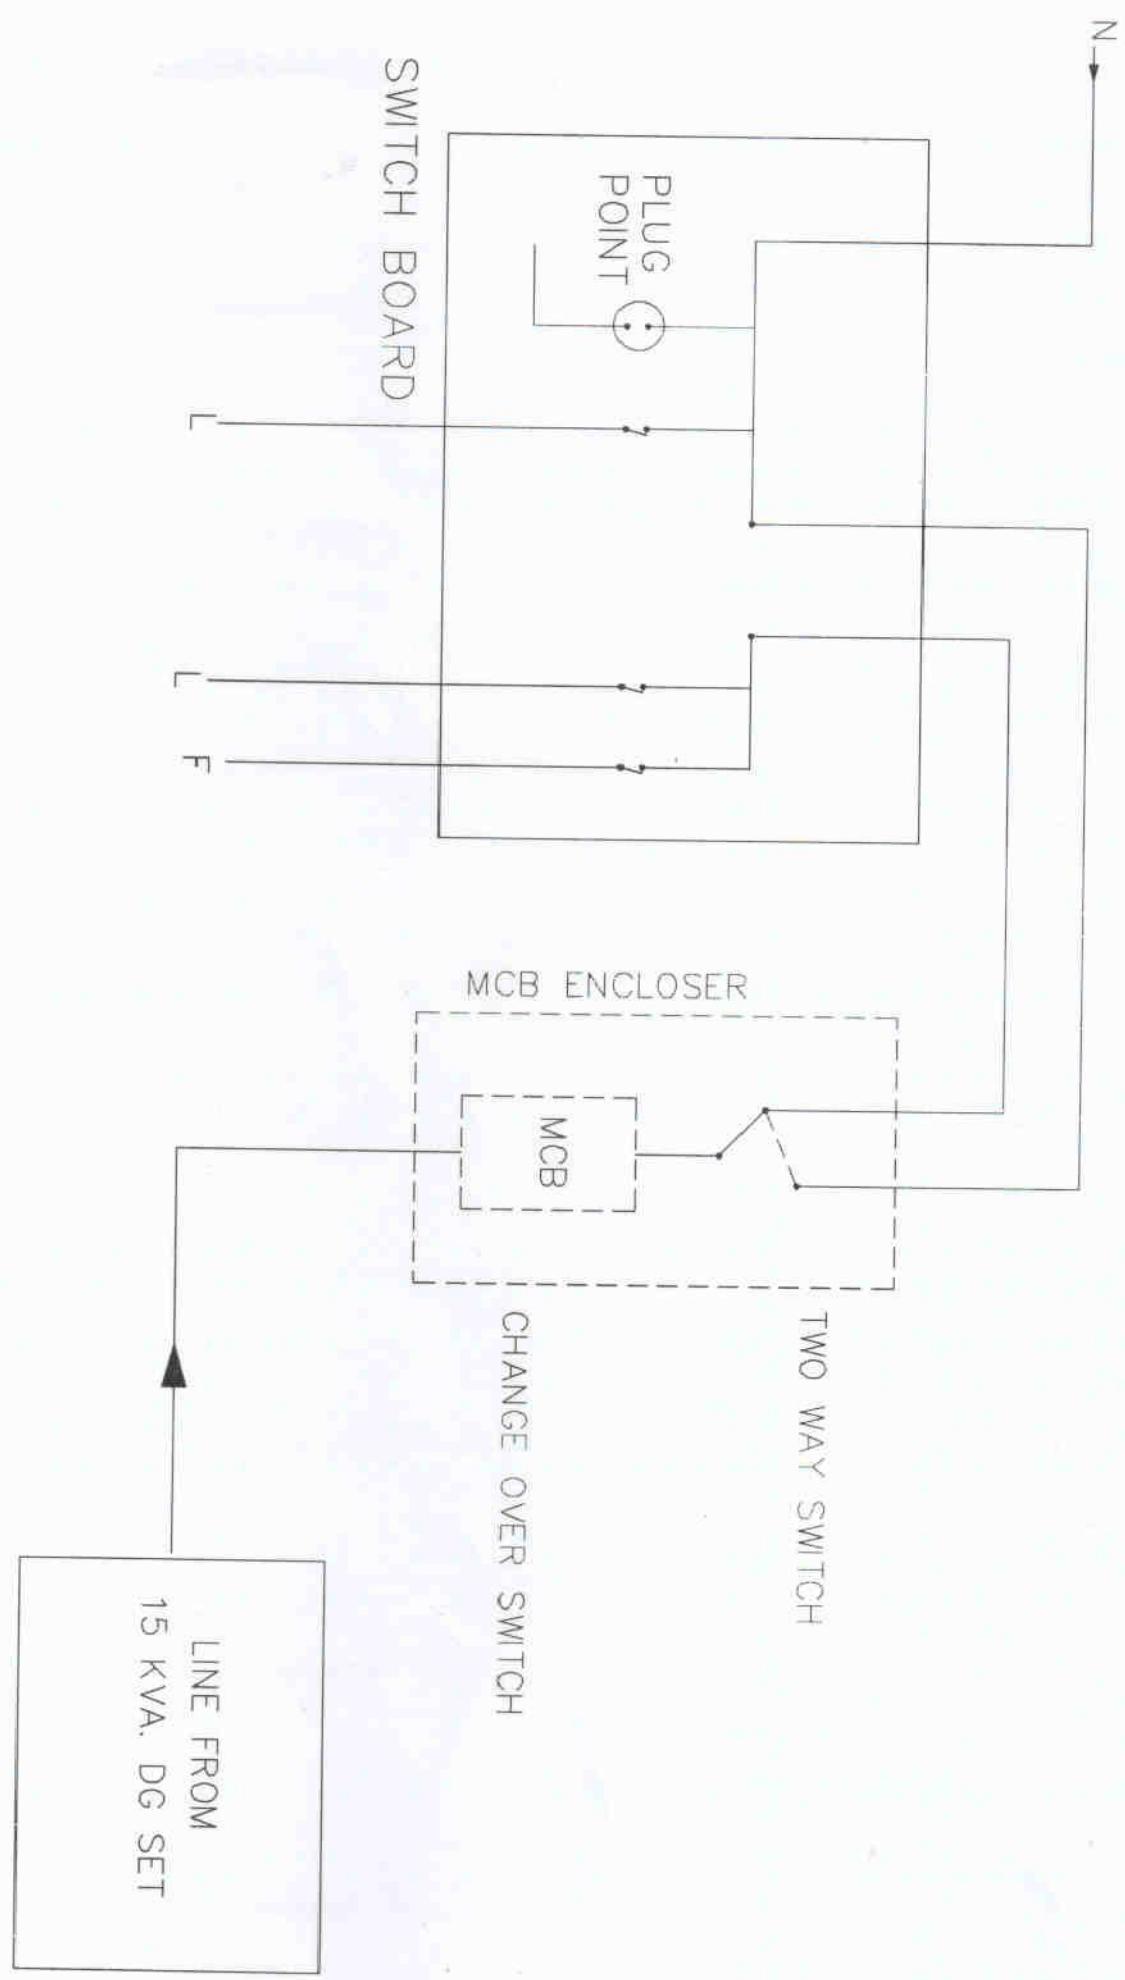

BOQ for Electrical works for two points power supply from 15 kVA DG set (under installation)to hutments and office at Singhpur Expl. Camp, Shahdol (MP) of CMPDI , RI-V Bilaspur (CG)					
Sl. No.	Ref No	Description		Unit	Qty.
1	DSR-2013/1.23.2	Supplying and fixing of 2 way 5/6 amps piano type switch on the existing switch box/ cover including connections etc. as required .		Each	76
2	item code 9.1.33	Supplying and making end termination with brass compression gland and aluminium lugs for 4 x 16 sq. mm (28 mm) size of PVC insulated and PVC Sheathed/ XLPE aluminium conductor cable of 1.1 KV grade as required.		Each	40
3	1.17.1	supplying and drawing 1 X 1.5 sq.mm sizes of FRLS PVC insulated copper conductor, single core cable in the existing surface / recessed steel/ PVC conduit as required.		Mtr.	900
4	1.17.20	supplying and drawing 2 X 4 sq.mm sizes of FRLS PVC insulated copper conductor, single core cable in the existing surface / recessed steel/ PVC conduit as required.		Mtr.	100
5	2.2.15	Providing and fixing of 200 Amp,36 KA, FPMCCB rating and breaking capacity and pole MCCB in existing cubicle panel board including drilling holes in cubical panel, making connections, etc. as required.		Each	1
6	1.21.1	Supplying and fixing of 20 mm size of medium class PVC conduit alongwith accessories in surface / recess including cutting the wall and making good the same in case of recessed conduit as required.		Metre	850
7	Item code 1742	Sheet steel DP MCB Enclosure		Each	76
8	SOR-2010/11.11.1	Supplying and fixing of 0.5 amps to 5 amps (1 amp required) SP MCB , 240 volts, 'C' series, suitable for inductive load in the existing MCB DB complete with connections, testing and commissioning etc. as required.		Each	76
9	12.4.1	Providing and fixing metal clad ,4 pole, 63 Amps on load change over switch unit (with sheet steel enclosure), 415/500 V in cubicle panel including drilling holes on the board connectons earthing the body , testing and commissioning etc. as required.(connecting lead if required shall be paid separately.		Each	1
10	17.1.23	Supplying and laying of 4 x 16 sq. mm size one number PVC insulated , PVC sheathed , steel armoured, aluminium conductor power cable of 1.1 KV grade direct in ground including excavation, sand cushioning, protective covering and refilling the trench etc as required.		Mtr	1100
11	17.1.24	Supplying and laying of 4 x 25 sq. mm size one number PVC insulated , PVC sheathed , steel armoured, aluminium conductor power cable of 1.1 KV grade direct in ground including excavation, sand cushioning, protective covering and refilling the trench etc as required.		Mtr	185
12	6.2.5	Supplying and fixing of 200mmx150mm wooden switch box made of wooden plank side wall and base including 3mm thick phenolic laminated sheet cover on surface complete as required.		Each	77
13	21.15.1	Supplying and fixing water tight terminal box made of 1.6mm thick MS sheet with detachable gland plate in bottom hinged front openable cover rubber gasket having 2 Nos. 4 way connector and 1 No. SPMCB (5amp) inside the box for cable connection fixed to pole with 2 Nos. clamp made from 40x3 mm MS flat with 2 No. nut bolt duly painted with 2 coat of red oxide paint and 2 coat aluminium paint complete as required. (20x15x15 cms)		Each	20
14	9.21	Fabrication, Supply, installation, testing and commissioning of cubicle type compartmentalized wall /floor mounted power cum control panel board of specified size and depth above 300 mm and upto 450mm made out of not less than 2 mm thick CRCA MS sheet with suitable size compartments for bus bars, switch gears and necessary cutouts for voltmeters, ammeters etc as per specifications including powder coating painting but without busbars, switchgears and other accessories etc. complete as required. (Only face area is to be measured)		sqm	1.25

Format of affidavit to be submitted by the bidders

Non-Judicial Stamp

AFFIDAVIT

I, _____ partner/legal attorney/accredited representative of _____ M/s.
solemnly declare that -

1. I/we am/are submitting tender for the work against tender Notice No. dated _____.

2. None of the partners of our firm is relative of employee of CMPDIL.

3. All information furnished by us in respect of fulfilment of eligibility criteria and qualification information this tender is complete, correct and true.

4. All documents/credentials submitted along with this tender are genuine, authentic, true and valid.

5. If any information and document submitted is found to be false/incorrect at any time, department may cancel my tender and action as deemed fit may be taken against us, including termination of the contract, forfeiture of all dues including earnest money and banning/de-listing of our firm and all partners of the firm etc.

6. Certified that I/we have not been banned or de-listed by any Government or Quasi Government agencies or PSUs.

Signature of the Tenderer

Dated _____

Seal of Notary

TEST CERTIFICATE & MAINTENANCE GUARANTEE

- (1) We certify that the Electrical works (two points) power supply from 15 kVA DG set to hutments at Singhpur Exploration camp, Shahdol (MP) of CMPDI, RI-V Bilaspur executed by us for CMPDI RI-V Bilaspur vide work order No..... dated to the best of our knowledge and belief, comply with Indian Electricity Rules, 1956 as well as IS:732-1963: Code of practice for electrical wiring installations (System Voltage not exceeding 650 Volts) (Revised).
- (2) We guarantee the installations as mentioned above for a period of twelve months against defective materials and workmanship, the guarantee commencing from the date the installation is taken over by CMPDI and during the period of guarantee. we shall rectify or replace defects in material or workmanship free of cost to CMPDI.
- (3) We submit herewith two sets of drawings showing the installations as actually executed.

Signature of Contractor

Name :

Address :

APPROVED VENDORS LIST FOR ELECTRICAL ITEM

S.N.	Item Description	Name of approved Manufactures
1.	Power distribution boards/Isolator/ MCCB/MCB	NGEF/ L&T/ ANDREW YULE/ GE INDUSTRIAL / JYOTI/ SIEMENS/ BHARATIA INDUSTRIES LTD./ ABB/ EASUN ENGG/ CROMPTON GREAVES/ KIRLOSKAR/ SYSTEMS / SCHNEIDER/ CONTROL & SWITCHGEAR COMPANY/ MINILEC(INDIA) PVT LTD/ STANDARD/ ELECTRICALS LTD/ JOLLY ENGG./ TRANSGIETZ/ MEGAWIN SWITCHGEAR/ MEDITRON/ Amiya Industries/ ZENITH CONTROLS/ HPL India./PRAYAS AUTOMATION/ AC Power System/ ELECTRO TEKNICA/Voltech Controls and Automation Pvt Ltd./ OPG Power Systems/ Aadroit Enginers/ Pascal Switchcare.
2.	Cables & Wires	CABLE CORPORATION/ FORT GLOSTER/ UNIVERSAL CABLES/ NICCO/ PREMIER CABLES/ HINDUSTAN CABLES/ INCAB/ ASEAN / HAVELLS/ RADIANT/ LASER CABLES/ SKYTONE/ LUMINO/ SIECHEM / Ravin Cables Ltd./ KEI INDUSTRIES/ HPL India(upto 1.1kV)/ Crystal Cable Industries/ Polycab wires pvt. Ltd./ Thermo Cables/Skytone Electricals India Ltd./KEC International Ltd.

S A F E T Y C O D E

- (i) Suitable scaffolds should be provided for workmen for all works that cannot be safety to be done from the ground or from solid construction except such short period work as can be done safety from ladders. When a ladder is used an extra mazdoor shall be engaged for holding the ladder and if the ladder is used in carrying materials as well, suitable foot holds and handholds shall be provided on the ladder and the ladder shall be given an inclination not steeper than $\frac{1}{4}$ to 1 ($\frac{1}{4}$ horizontal and 1 vertical).
- (ii) Scaffolding or staging more than 12' above the ground or floor or suspended from over-head support of erected with stationary support shall have a guard rail properly attached, bolted, braced and otherwise secured at least 3 ft. high above floor or platform of such scaffolding or staging and ends thereof with only such openings as may be necessary for the delivery of materials. Such scaffolding or staging shall be so fastened as to prevent it from swaying from the building or structure.
- (iii) Working platform gangways and stairways should be so constructed that they should not sag unduly or unequally, and if the height of the platform or the gangway or the stairway is more than 12 ft. above ground level or floor level, they should be closely board, should have adequate width and should be suitable fenced as described in (i) above.
- (iv) Every opening in the floor of a building or in working platform be provided with suitable means to prevent the fall of persons or materials by providing suitable, fencing or railing whose minimum height shall be 3 ft.
- (v) Safe means of access shall be provided to all working platform and other working places. Every ladder shall be provided securely fixed. No portable single ladder shall be over 30 ft. in length while the width between side rails in rung ladder shall in no case be less than $11 - \frac{1}{2}$ " for ladder upto and including 10 ft. in length. For longer ladders this width should be increased at least $\frac{1}{4}$ % for each additional foot of length. Uniform step spacing shall not be exceeded 12". Adequate precautions shall be taken to prevent danger from electrical equipments. No material on any of the sites of work shall be stacked or placed as to cause danger or inconvenience to any person or the public. The contractor shall also provide all necessary fencing and lights to protect the public from accident and shall be bound to bear the expenses of defence of every suit, action or other proceedings at all that may be brought by any person for injury sustained owing to neglect of the above precautions and to pay damages and cost which may with the consent of the contractor, he has paid to compromise any claim by any such persons.
- (vi) All trenches four feet or more in depth, shall at all times be supplied with atleast one ladder for each 100 ft. in length or fraction thereof. Ladder shall be extended from bottom of the trench to atleast 3' above surface of the ground. The side of the trenches which are 5 ft. or more in depth shall be stopped back to give suitable slope or securely held by timber bracing, so as to avoid the danger of sides to collapse. The excavated materials shall not be placed within 5 ft. of the edge of the trench or half of the trench whichever is more. Cutting shall be done from top to bottom. Under no circumstances under mining or under cutting shall be done.
- (vii) No electric cable or apparatus which is liable to be source of danger over a cable or apparatus sued by the operator shall remain, electrically charged.
- (viii) All necessary personal safety equipment as considered adequate by the Engineer In charge should be kept available for the use of the persons employed on the site and maintained in a condition suitable for immediate use and the contractor should take adequate steps to ensure proper use of equipment by those concerned.
- (ix) Those engaged in welding works shall be provided with protective goggles, etc.
- (x) The contractor shall not employ men below the age of 18 and women on the work of painting with products containing lead in any form. Whenever man above age of 18 years are employed for the work of lead paining the following precautions should be taken.
When workers employed on electrical installations which are already energized, insulating mats, wearing apparel such as Gloves, Sleeves and boots as may be necessary should be provided. The workers should not wear rings, watches and carry keys or other materials which are good conductors of electricity.
- (xi) All scaffolds, ladders and other safety devices mentioned or described herein shall be maintained in safe conditions and no scaffold, ladder or equipment shall be altered or removed while it is used. Adequate washing facilities shall be provided or near places of work.
- (xii) To ensure effective enforcement of the rules & regulations relating to safety precautions, the arrangements made by the contractor shall be open to inspection by the Labour Officer, Engineer In charge of the department of their representatives.
- (xiii) Notwithstanding the above clauses form (i) to (xii) there is nothing in these to exempt the contractor from that operations of any other Act or rules in force in Republic of India.

GENERAL TERMS AND CONDITIONS FOR TENDER

1. Definitions

- i) "**Employer**" or "**Company**" means the Coal India Limited or any of its subsidiaries represented by the appropriate authority who will employ the contractor.
- ii) "**Principal Employer**" means the Coal India Limited or any of its subsidiaries or the officer nominated by the company to function on its behalf.
- iii) The word "**Contractor/ Contractors**" wherever occurs means the successful tenderer/ tenderers who has/have deposited the necessary Earnest money and has/have been given written intimation about the acceptance of tender and shall include legal representative of such individual or persons composing a firm or a company or the successors and permitted assignees of such individual, firm or Company, as the case may be.
- iv) "**Site**" means the land and places including any building and erection thereon, over, under, in or through which the Permanent works or Temporary works designed by the Engineer In charge- are to be executed and any other lands and places provided by the Employer for working space or any other purpose as may be specifically designated in the Contract as forming part of the site.
- v) The term "**Sub-Contractor**" as employed herein, includes those having a direct contract with Contractor either on piece rate, item rate, time rate or any other basis and it includes one who furnishes work to a special design according to the plans or specifications of this work but does not include one who merely supplies materials.
- vi) "**Accepting Authority**" shall mean the management of the company and includes an authorised representative of the company or any other person or body of persons empowered in this behalf by the company.
- vii) "**Engineer In charge**" shall mean the officer nominated by the company in the E&M Engineering in cadre/discipline who is competent to direct supervisors and authorised to be in charge of the works for the purpose of this contract. The Engineer In charge-/designated Officer- who is of an appropriate seniority, will be responsible for supervising and administering the contract, certifying payments due to the contractor, valuing variations to the contract, awarding extension of time and valuing compensation events. The Engineer In charge-/Designated Officer- may further appoint his representatives i.e. another person/Project Manager or any other competent person and notify to the contractor who is directly responsible for supervising the work being executed at the site, on his behalf under their delegation of powers of the company. However, overall responsibility, as far as the contract is concerned, will be that of the Engineer In charge-/Designated Officer-.
- viii) The "**Contract**" shall mean the notice inviting tender, the tender as accepted by the Company, the work order issued to the contractor, and the formal contract agreement executed between the company and the contractor together with the documents referred to therein including general terms and conditions special conditions, if any, scope of work, frozen terms & conditions/technical parameters/scope of work and revised offer, if any, specifications, drawings, including those to be submitted during progress of work, schedule of quantities with rates and amounts.
- ix) A "**Day**" shall mean a day of 24 hours from midnight to midnight.
- x) The "**Work**" shall mean the works required to be executed in accordance with the contract/work order or parts thereof as the case may be and shall include all extra or additional, altered or substituted works or any work of emergent nature, which in the opinion of the Engineer In charge, become necessary during the progress of the works to obviate any risk or accident or failure or become necessary for security.
- xi) "**Schedule of Rates**" referred to in this conditions shall mean the standard schedule of rates prescribed by the company and the amendments issued from time to time.
- xii) "**Contract amount**" shall mean:
 - a) in the case of turn key contracts the total sum for which tender is accepted by the company.
 - b) in the case of other types of contracts the total sum arrived at based on the individual rates quoted by the tenderer for the various items shown in the "**Schedule of Quantities**" of the tender document as accepted by the Company with or without any alteration as the case may be.
- xiii) "**Written notice**" shall mean a notice or communication in writing and shall be deemed to have been duly served if delivered in persons to the individual or to a member of the contractors firm or to an office of the company for whom it is intended, or if delivered at or sent by registered mail to the last business address known to him who gives the notice.
- xiv) "**The constructional plant**" means all appliances, tools, plants or machinery or whatsoever nature required in or about the execution, completion or maintenance of the works but does not include materials or other things intended to form part of the permanent work.
- xv) "**The Letter of Acceptance of Tender**" means letter giving intimation to the tenderer that his tender has been accepted in accordance with the provisions contained in that letter.

- xvi) "Department" means the E&M Engineering Department of Coal India Limited or any of its subsidiaries represented by the appropriate authority.
- xvii) 'Act of insolvency' means as it is designed by Presidency Town Insolvency Act or Provincial Insolvency Act or any act amending such originals.
- xviii) The words indicating the singular only also include the plural and vice-versa where the context so requires.

2. Contract Documents:

The following documents shall constitute the contract documents :

- i) Notice Inviting Tender/Detailed Tender Notice.
- ii) Articles of Agreement / Letter of Acceptance of Tender/Work Order.
- iii) General Terms & Conditions of contract/Commercial Terms & Conditions of contract.
- iv) Additional Terms & Conditions of contract, if any.
- v) Specifications.
- vi) Schedule of quantities(or Bill of Quantities)/ Schedule of work/Scope of work.
- vii) Frozen terms & conditions / technical parameters/ scope of work and revised offer, if any.
- viii) Contract drawings and work programme.
- ix) Safety Code etc. forming part of the tender.

N.B. Deviations :

Deviations sought by the bidders whether they are technical or commercial deviations, must only be given in the schedules prescribed for them. Any wilful attempt by the bidders to camouflage the deviations by giving them in the covering letter or in any other documents than the prescribed schedules may render the bid itself as non-responsive.

- 2.1 The contractor shall enter into and execute contract agreement in the prescribed form to be supplied by the department (Applicable for contracts of more than Rs.5 lakhs value). The cost of the stamp papers for the contract agreement shall be borne by the contractor. Two sets of contract document/agreements shall be prepared and signed by both the parties. One of the sets shall be stamped "Original" and the other "Duplicate". The duplicate copy will be supplied to the contractor free of cost and the original is to be retained by the company. For any additional copies required by the contractors the price to be charged would be that of the cost of the Tender Document (Application Fee).

All additional copies should be certified by the Engineer In charge-.

The contractor shall keep copy of these documents on the site/place of work in proper manner so that these are available for inspection at all reasonable times by the Engineer In charge-, his representatives or any other officials authorized by the company for the purpose.

- 2.2 The contract document shall not be used by the contractor for any purpose other than this contract & the contractor shall ensure that all persons employed for this contract strictly adhere to this and maintain secrecy, as required of such documents.

2.3 Tender Evaluation & Bid Assessment

The tenders received will be scrutinized & evaluated by a duly constituted Tender Committee.

The Tender Committee will examine the Comparative Statement prepared by the concerned technical Deptt. will satisfy itself that all aspects/conditions of each offer has been properly evaluated with respect to financial implications etc.

Tenders received without Earnest Money will be rejected.

The deviations from the commercial terms & conditions & the tender specifications are scrutinized before opening of price bids. Normally no deviations in the commercial terms & conditions will be accepted.

However, the Tender Committee may decide to scrutinize the different conditions given by the tenderers and formulate and freeze the acceptable conditions and intimate all the tenderers about the same and give them an opportunity to revise their price bid if necessary before opening the same.

The Price Bids are opened at the time and place fixed for the same in presence of the tenderers & committee members and due information for opening of Price Bid is to be given to all concerned. In case where the tenderers are given opportunity to revise their Price Bids, only the revised price bids are opened and the original Price Bids are to be kept in tact in the custody of the company.

The Price Bids of the tenderers will have no condition. The Price Bids which are incomplete & not submitted as per instructions given in the Tender Document will be rejected.

No document presented by the bidder after the closing date & time of the bid will be taken into account unless it is of purely technical nature and which has no bearing financially on the contract & which does not seek major changes in the technical specifications given in the bid documents. If a bidder offers a rebate unilaterally after the closing date & time of the bid, it will not be taken into account for evaluating purposes by the Tender Committee, but if that bidder emerges as the lowest evaluated, the rebate offered will be taken into account for determination of the total offer.

If the bid of the successful bidder is seriously unbalanced in relation to the estimate of the cost of work to be performed under the contract, the company may require the bidder to produce detailed price analysis for any or all items of the bill of quantities to demonstrate the internal consistency of these prices with the construction method and the schedule proposed. After evaluation of the price analysis, the company may require that the amount of the performance security/security deposit is increased at the expense of the successful bidder to a level sufficient to protect the company against financial loss in the even of default on the part of the successful bidder under the contract.

2.4 Abnormally High Rate (AHR) & Abnormally Low Rate (ALR) Items

Abnormally High rates & Abnormally Low Rates, if quoted by the contractor, in item rate tenders will be identified & dealt with as under :

- i) For identification AHR & ALR items the ceiling of +/- 20% respectively, when compared with the updated estimated rate, will be considered.
- ii) Variation in Quantity on quoted rate during execution for AHR & ALR items shall be permitted upto +/-25% (+25% for AHR & -25% for ALR) of the quantity provided for items of work below plinth level & +/-5% of the quantity provided for items of work above plinth level respectively.
- iii) Quantity variation beyond the limit mentioned at ii) above shall be dealt by arriving at new rate based on prevalent market rates of materials & labour analysed as per standard analysis of rate of N.B.O./C.P.W.D. Payment of extra quantity over the permitted quantity of +/-25% and +/-5% (as the case may be) would be made on the basis of the new analysed rate or quoted rate whichever is less.
- iv) For identified abnormally low rate (ALR) items, the contractor will be required to deposit with the company the difference in amount calculated between the departmental justified rate multiplied by the quantity of a particular ALR item and the ALR rate quoted by the contractor multiplied by the quantity of the same item.

The total amount to be deposited will be the sum total of all the identified ALR items calculated as per the method outlined above.

The amount so retained will be refunded on successful completion of individual ALR items of work.

2.5 Deleted :

2.6 Acceptance of Offer:

Letter of Acceptance is an acceptance of offer by the company and it need not be accepted by the tenderer. But the tenderer should acknowledge the receipt of the order within 15 days of mailing of work order and any delay in acknowledging the receipt will be treated as a breach of contract and compensation for the loss caused by such breach will be declared by the company by forfeiting EMD/Bid bond.

2.7 Banned or delisted contractors :

The bidders would give a declaration that they have not been banned or delisted by any Govt. or Quasi Govt. agencies of PSU's. If a bidder has been banned or delisted by any Govt. or Quasi Govt. agencies of PSU's this fact must be clearly stated and it may not necessarily be a cause for disqualification. If the declaration is not given, the bid will be rejected as non-responsive.

3. Discrepancies in contract documents & Adjustments thereof

The documents forming part of the contract are to be treated as mutually explanatory of one another and in case of discrepancy between schedule of quantity, the specifications and/or drawing, the following order of preference shall be observed;

- a) Description in Bill of quantities of work.
- b) Particular specification and special conditions, if any
- c) Drawings.
- d) General specifications.

3.1 In the event of varying or conflicting provision in any of the document(s) forming part of the contract, the Accepting Authority's decision/clarification shall hold good with regard to the intention of the document or contract as the case may be.

3.2 Any error in description, quantity or rate in Bill of quantities or any omission there from, shall not vitiate the contract or release the contractor from discharging his obligations under the contract including execution of work according to the Drawings and Specifications forming part of the particular contract document.

3.3 Any difference detected in the tender/tenders submitted resulting from :

a) discrepancy between description in words and figures, the rate which corresponds to the amount worked out by the contractor shall be taken as correct.

b) discrepancy in the amount quoted by the contractor due to calculation mistake of the unit rate and quantity, the unit rate shall be regarded as firm and amount corrected.

c) discrepancy in totalling or carry forward in the amount quoted by the contractor shall be corrected.

The tendered sum so corrected and altered shall be substituted for the sum originally tendered and considered for acceptance instead of the original sum quoted by the tenderer alongwith other tender/tenders. Rounding off to the nearest rupee should be done in the final summary of the amount instead of in totals of various sections of the offer.

4. Security Deposit :

4.1.1 Security Deposit shall consist of two parts;

a) Performance Security to be submitted at award of work, and
b) Retention Money to be recovered from running bills.

The security deposit shall bear no interest.

4.1.2 Performance security should be 5% of contract amount and should be submitted within 28 days of receipt of LOA by the successful bidders in any of the form given below:

- a Bank Guarantee in the form given in the bid document
- Govt. Securities, FDR or any other form of deposit stipulated by the owner
- Demand Draft drawn in favour of CMPDI RI- V Bilaspur on any scheduled Bank payable at its Branch at Bilaspur.....

The Earnest Money/Bid Security deposited in the form of Bank Guarantee shall be discharged when the Bidder has signed the Agreement and furnished the required Performance Security/Security Deposit. The bid security deposited in the form of Demand draft/cash shall be adjusted against the security deposit.

If performance security is provided by the successful bidders in the form of bank guarantee it shall be issued either –

- (a) at Bidder's option by a nationalized/Scheduled Indian Bank or
- (b) by a foreign bank located in India and acceptable to the employer
- (c) the validity of the Bank Guarantee shall be for a period of one year or ninety days beyond the period of contract, whichever is more.

Failure of the successful bidder to comply with the requirement as above shall constitute sufficient ground for cancellation of the award of work and forfeiture of the bid security.

4.2.1 All running on account bills shall be paid at 95% (ninety five percent) of work value. This 5% (five percent) deduction towards Retention Money will be the second part of security deposit.

4.2.2 5% Performance Security should be refunded within 14 days of the issue of defect liability certificate (taking over certificate with a list of defects). Retention Money should be refunded after issue of No Defect Certificate. Retention Money should be deducted at 5% from running bills.

4.3 The Bank Guarantee towards security deposit shall be acceptable only for values above Rs.50,000/- and the Bank Guarantee shall also be valid for a minimum period of one year or the period of contract plus the period of retention of security deposit (as described hereafter) or six months whichever is more. Bank Guarantee is to be submitted in the format prescribed by the company. Bank Guarantee shall be irrevocable and will be from the amongst the list of Banks (Scheduled Banks) provided in the bid document.

4.4 The company shall be at liberty to deduct/appropriate from the security deposit such sums as are due and payable by the contractor to the company as may be determined in terms of the contract, and the amount appropriated from the security deposit shall have to be restored by further deduction from the contractors subsequent on account running bills, if any.

The refund of security deposit shall be subject to company's right to deduct appropriate its due against the contractor under this contract or under any other contract.

4.5 On completion of the entire work and certified as such by the Engineer In charge- and on passing of the final bill by the Department, one half of the security deposit lying with the company shall be refunded to the contractor. The other half

shall be refunded to the contractor on the expiry of six months from the date of completion as certified by the Engineer In charge- subject to the following conditions.

a) Any defect/defects in the work, if detected after issue of completion certificate is/are rectified to the satisfaction of the Engineer In charge- within the said period of six months.

b) In the case of building work/other work of similar nature, the refund shall be made on the expiry of the said six months period or at the end of one full monsoon period i.e. June to September, whichever is later in point of time and any defects such as leakage in roof, efflorescence in walls, dampness, defects in drainage etc. should be rectified to the satisfaction Engineer In charge-.

5. Deviations/Variations in Quantities and Pricing

The quantities given in the 'Schedule of Quantities' are based on estimates and are meant to indicate the extent of the work and to provide a uniform basis for tendering and any variation either by addition or omission shall not vitiate the contract.

5.1 The company through its Engineer In charge or his representative shall, without radically changing the original scope and nature of the work, under contract, have power to make any alterations in or additions to or substitution of the original specifications, drawings, designs and instructions that may appear to be necessary or advisable during the progress of the work.

The contractor shall be bound to carry out the works in accordance with the instructions given to him in writing by the Engineer In charge or his representative on behalf of the company. Such altered or additional or substituted work, which shall form part of the original contract, shall be carried out by the contractor on the same terms and conditions in all respects on which they agreed to do the main work and at the same rate/rates as are specified in the contract/ work order.

5.2 The right is reserved to cancel any items of work included in the contract agreement or portion thereof in any stage of execution if found necessary to the work and such omission shall not be a waiver of any condition of the contract nor invalidate any of the provisions thereof.

5.3 If the additional, altered or substituted work includes any class of work for which rate/rates is/are not specified in the contract/work order, rates for such items shall be determined by the Engineer In charge- as follows :

a) In case of percentage tenders, if the rate for the item of work executed is available in the company's approved SOR, it will be paid at the schedule rate plus or minus the accepted percentage as per contract.

b) In case of item rate tenders, the rate for extra item shall be derived from the rate for similar item or near similar item of work available in the agreement schedule of work or by analysis of rates as at (E&M) below and the lower rate out of the above two shall be considered.

c) In case the rate for extra item is to be derived by analysis of rate, the same shall be done by analysis on prevalent market rate of materials and labour based on standard norms of analysis or rate of N.B.O./C.P.W.D.

d) In case of combined tender with partly item rate for non-schedule items & partly percentage tenders for SOR items, the rate for extra item shall be derived as at (b) above in case of non-schedule items rates and in case of percentage rates for SOR items the rate for extra item shall be derived as at (a) above.

In case of any difference between the contractor and the Engineer In charge- as to the fixation of rates, the matter shall be referred to the accepting authority of the company i.e. CGM(E&M)/GM(E&M)/CE(E&M) of the company or staff Officer(E&M) for the work awarded at Company Hqrs. Level and Area level respectively, whose decision shall be final and binding on the contractor.

5.4 Payment for such deviated items (additional/altered/substituted items of work or excess quantities of work beyond +/- 25% of the agreement schedule) shall be made in the contractor's running on account bills, till the revised estimate regularizing these items are sanctioned by the competent authority of the company, at the provisional rates and shall not exceed :

a) 75% of rate recommended by the Engineer In charge- to the accepting authority of the company, i.e. CGM(E&M)/GM(E&M)/CE(E&M) of the company or SO(E&M) of the Area, if the rate is directly available in the SOR of the company.

b) 50% of the rate recommended by the Engineer In charge- to the accepting authority of the company i.e. CGM(E&M)/GM(E&M)/CE(E&M) of the company or SO(E&M) of the Area, if it is analysed item rates based on prevalent market rates of materials and labour following NBO/CPWD norms.

5.5 The time for completion of the originally contracted work shall be extended by the company in the proportion that the additional work (in value) bears to the original contracted work (in value) plus 25% of the time calculated as explained above or such further additional time as may be considered reasonable by the Engineer In charge-.

5.6 The company through its Engineer In charge- or his representative, on behalf of the company, shall have power to omit any part of the work in case of non-availability of a portion of the site or for any other reason and the contractor shall be bound to carry out the rest of the work in accordance with the instructions given by the Engineer In charge In charge. No claim from the contractor shall be entertained/accepted on these grounds.

5.7 In the event of any deviation being ordered which in the opinion of the contractor changes radically the original scope/nature of the contract, the contractor shall under no circumstances suspend the work, either original or altered or

substituted, and the dispute/disagreement as to the nature of deviation and the rate/rates to be paid for such deviations shall be resolved separately with the company as per procedures/norms laid down hereafter.

6. Time for Completion of Contract, Extension there of, Defaults and Compensation for delay

6.0 Time is the essence of the contract and as such all works shall be completed within the time stipulated in the contract/work order.

Immediately after the contract is executed/the work order is issued, the Engineer In charge and the contractor shall agree upon a detailed time and progress chart prepared based on BAR CHART/ PERT CPM techniques on the basis of a construction schedule submitted by the contractor at the time of executing contract showing the order in which the work is proposed to be carried out within the time specified in the contract document/work order. For the purpose of this detailed time and progress chart, the work shall be deemed to have commenced on the expiry of 10 (ten) days from the issue of Letter of Acceptance of Tender/Work Order or handing over the site of work or handing over reasonable number of working drawings to the contractor or the period of mobilisation allowed in the work order for starting the work in special circumstances, whichever is later.

6.1 If the contractor, without reasonable cause or valid reasons, commits default in commencing the work within the aforesaid time limit, the company shall without prejudice to any other right or remedy, be at liberty, by giving 15 days notice in writing to the contractor to commence the work, to forfeit the Earnest Money deposited by him and to rescind the Letter of Acceptance of Tender/Work Order.

Additionally, the Company will reserve the right to debar such defaulting Contractors from participating in future Tenders for a minimum period of 1 (one) year.

6.2 If the contractor fails to maintain the required progress in terms of the agreed time and progress chart or to complete the work and clear the site on or before the contract or extended date of completion, he shall without prejudice to any other right or remedy available under the law to the company on account of such breach, pay as compensation (Liquidated Damages) @ half percent (1/2%) of the contract price per week of delay. The aggregate of such compensation/compensations shall not exceed 10(ten) percent of the total value as shown in the contract.

This will also apply to items or group of items for which separate period of completion has been specified. The amount of compensation may be adjusted or set off against any sum payable to the contractor under this or any other contract with the company.

6.2.1 The company, if satisfied, that the works can be completed by the contractor within a reasonable time after the specified time of completion, may allow further extension of time at its discretion with or without the levy of L.D. In the event of extension granted being with L.D., the company will be entitled without prejudice to any other right or remedy available in that behalf, to recover from the contractor as agreed damages equivalent to half percent of the contract value of the works for each week or part of the week subject to a ceiling of 10% of the contract price.

6.2.2 The company, if not satisfied that the works can be completed by the contractor, and in the event of failure on the part of the contractor to complete work within further extension of time allowed as aforesaid, shall be entitled, without prejudice to any other right, or remedy available in that behalf, to rescind the contract.

6.2.3 The company, if not satisfied with the progress of the contract and in the event of failure of the contractor to recoup the delays in the mutually agreed time frame, shall be entitled to terminate the contract.

6.2.4 In the event of such termination of the contract as described in clauses 6.2.2 or 6.2.3 or both, the company shall be entitled to recover. L.D. upto ten percent (10%) of the contract value and forfeit the security deposit made by the contractor besides getting the work completed by other means at the risk and cost of the contractor.

6.3.a) The company may at its sole discretion, waive the payment of compensation on request received from the contractor indicating valid and acceptable reasons if the entire work is completed within the date as specified in the contract/work order or as validly extended date without stipulating any compensation for delay.

or

(b) If the progress of the work or of any portion of the work is unsatisfactory, the Engineer In charge shall be entitled, after giving the contractor 15 days' notice in writing, to employ another Agency for executing the job or to carry out the work departmentally either wholly or partly debiting the contractor with the cost involved in engaging another Agency or the cost involved in executing the work departmentally, as the case may be. The certificate to be issued by the Engineer In charge In-charge for the cost of the work so done shall be final and conclusive and the extra cost, if any, shall be borne by the contractor.

6.4 Extension of date of completion : On occurrences of any events causing delay as stated here-under, the contractor shall intimate immediately in writing to the Engineer In charge.

a) Force Majeure - i) Natural phenomena, including but not limited to abnormally bad weather, unprecedeted flood and draught, earthquakes & epidemics.

ii) Political upheaval, E&M commotion, strikes, lockouts, acts of any Govt.(domestic/foreign) including but not limited to war, properties, quarantine embargoes.

The successful bidder will advise in the event of his having to resort to this clause by a registered letter duly certified by the local chamber of commerce or statutory authorities, the beginning and end of the cause of delay, within fifteen days of the occurrence and cessation of such Force Majeure condition.

In the event of delay due to Force Majeure for more than one month the contract may be terminated at the discretion of the company. Termination under such circumstances will be without any liability on either side.

b) Serious loss or damage by fire

c) Non-availability of stores which are the responsibility of the company to supply as per contract

d) Non-availability of working drawings in time, which are to be made available by the company as per contract during progress of the work

e) Delay on the part of the contractors or tradesmen engaged by the company not forming part of the contract, holding up further progress of the work

f) Non-availability or breakdown of tools and plant to be made available or made available by the company

g) The execution of any modified or additional items of work or excess quantity of work.

h) Any other causes which, at the sole discretion of the company, is beyond the control of the contractor.

6.4.1 A HINDRANCE REGISTER shall be maintained by both department and the contractor at site to record the various hindrances, as stated above, encountered during the course of execution.

Hindrance register will be signed by both the parties. The contractor may also record his observations in the Hindrance Register. In case the contractor has a different opinion for hindrance and a dispute arises, then the matter would be referred to the EIC and or the next higher authority whose decision would be final & binding on the contractor & the decision to be communicated within 15 days.

6.4.2 The contractor shall request the company in writing for extension of time within 15 days of happening of such event causing delay stating also, the period for which extension is required. The company may, considering the genuinity of the request, give a reasonable extension of time for completion of the work. Such extension shall be communicated to the contractor in writing by the company through the Engineer In charge In charge within 1 month of the date of receipt of such request.

6.4.3 The opinion of the Engineer In charge, whether the grounds shown for the extension of time are or are not reasonable, is final. If the Engineer In charge is of the opinion that the grounds shown by the contractor are not reasonable and declines to the grant of extension to time, the contractor can not challenge the soundness of the opinion by reference to arbitration.

The opinion of the Engineer In charge that the period of extension granted by him is proper or necessary is not, however, final. If the contractor feels that the period of extension granted is inadequate he can appeal to the CGM(E&M)/GM(E&M)/CE(E&M) of the company for consideration on the question whether the period of extension is or is not proper or necessary.

6.4.4 Provisional extension of time may also be granted by the Engineer In charge during the course of execution, on written request for extension of time within 15 days of happening of such events as stated above, reserving the company's right to impose/ waive penalty at the time of granting final extension of time as per contract agreement.

6.4.5 When the period fixed for the completion of the contract is about to expire, the question of extension of the contract may be considered at the instance of the Contractor or the Department or of both. The extension will have to be by party's agreement, express or implied.

In case the contractor does not apply for grant of extension of time within 15(Fifteen) days of the hindrance occurring in execution of the work and the department wants to continue with the work beyond the stipulated date of completion for reason of the work having been unavoidably hindered, the Engineer In charge-in-charge can grant extension of time even in the absence of application from the contractor. Such extension of time granted by the Engineer In charge- is valid provided the contractor accepts the same either expressly or implied by his actions before and subsequent to the date of completion. Such extension of time shall be without prejudice to Company's right to levy compensation under the relevant clause of the contract.

The contractor shall however use his best efforts to prevent or make good the delay by putting his endeavours constantly as may be reasonably required of him to the satisfaction of the Engineer In charge In charge.

7. Material Supply & Other facilities

7.1 The company does not undertake any responsibility for supply of any materials to the contractor.

7.6 All materials, tools and plants brought to site by the contractor including the materials supplied by the company shall be deemed to be held in lien by the company and the contractor shall not have the right to remove the same from the site, without the written permission of the Engineer In charge In charge. The company shall not however be liable for any loss,

theft or damage due to fire or other cause during this period of lien, the responsibility for which shall lie entirely on the contractor.

7.7 The contractor shall bear the cost of loading, transportation to site, unloading, storing under cover as required etc. as may be necessary for the use and keeping the materials in good condition.

7.9 On completion or on termination of the contract and on complete recovery of secured advance paid by the company, if any, in respect of materials brought to site, the contractor with due permission of the Engineer In charge In charge shall be entitled to remove at his expenses all surplus materials originally supplied by him and upon such removal, the same shall become the property of the contractor.

7.10 All charges on account of octroi, terminal or sales tax and other duties on materials obtained for the works from any source (excluding materials supplied by the company) shall be borne by the contractor.

7.11 The contractor shall arrange necessary electricity at his own cost for the work and his own establishment. However, if available and feasible the company may arrange electricity at one point near the work site and necessary recovery of cost of energy consumed will be made at rates prescribed by the company from time to time. Energy meter for this purpose shall be provided by the contractor.

7.12 The contractor shall arrange necessary water for the work and his own establishment. However, if available and feasible the company may arrange water at one point near the work site for which recovery @ 1% of the contract value of work done will be made from the contractor's bills.

8. Quality Assurance - Materials and Workmanship

The contractor shall carry out and complete the work in every respect in accordance with the contract and shall ensure that the work conforms strictly to the drawings, specifications, instructions of the Engineer In charge In charge. The Engineer In charge In charge may issue, from time to time, further drawings, detailed instructions/ directions in writing to the contractor. All such drawings, instructions/directions shall be consistent with the contract documents and should be reasonably inferable therefrom, alongwith clarifications/ explanations thereof, if necessary.

8.1 For Quality Assurances of all the E&M Engineer In chargeing Works the norms/ guidelines laid down by the company herein and else- where will form part of the contract for the purpose of quality of works

8.2 The contractor shall be responsible for correct and complete execution of the work in a workman like manner with the materials as per specification which shall be subject to the approval of the company. All work under execution in pursuance of the contract shall be open to inspection and supervision by the Engineer In charge or by his authorised representative or any other official of higher rank or any other person authorised by the company in his behalf & the contractor shall allow the same.

8.3 All materials to be provided by the contractor shall be in conformity with the specifications/schedule of work as per the contract and the contractor shall furnish proof, if so required by the Engineer In charge to his satisfaction that the materials do so comply.

8.4 The contractor shall immediately after the award of work draw up a schedule giving dates for submission of samples as required or necessary as per the specification for approval of Engineer In charge who shall approve, if found acceptable, promptly so that there is no delay in the progress of the work of the contractor or of the work of any of the sub-contractor.

On receipt of samples as per schedule, the Engineer In charge shall arrange to examine/test with reasonable promptness ensuring conformity of the samples with the required specification and complying with the requirements as per contract documents keeping in view that the work shall be in accordance with the samples approved by him. The contractor shall not start bringing materials at the site unless the respective samples are approved. Materials conforming to approved samples shall only be brought to the site.

Samples are to be supplied by the contractor at his own cost. The cost involved in tests shall be borne by the contractor. If any test is ordered by the Engineer In charge which is to be carried out by any independent person or agency at any place other than the site even then the cost of materials and testing charge etc. shall be borne by the contractor. If the test shows that the materials are not in accordance with the specifications, the said materials shall not be used in the work and removed from the site at contractors cost.

8.5 The company, through the Engineer In charge , shall have full powers to reject any materials or work due to a defect therein for not conforming to the required specification, or for materials not being of the required quality and standard or for reasons of poor workmanship or for not being in accordance with the sample approved by him.

The contractor shall forthwith remedy the defect/replace the materials at his expense and no further work shall be done pending such rectification/replacement of materials, if so instructed by the Engineer In charge-.

In case of default on the part of the contractor, the Engineer In charge shall be at liberty to procure the proper materials for replacement and/or to carry out the rectifications in any manner considered advisable under the circumstances and the entire cost & delay for such procurement/rectification shall be borne by the contractor.

8.6 The Engineer In charge shall be entitled to have tests carried out for any materials, according to the standard practice followed for such tests, other then those for which satisfactory proof has already been furnished by the contractor who shall provide at his expense all facilities which the Engineer In charge may require for the purpose.

The cost of any other tests, if so required by the Engineer In charge , shall be borne by the contractor only, if the test shows the workmanship or materials not to be in accordance with the provision of the contract or the instruction of Engineer In charge , but otherwise by the company.

8.7 Access to the works: The Engineer In charge and any person authorised by the company shall at all times have access to the works and to all workshops and places where work is being prepared or from where materials, manufactured articles are being obtained for the works and the contractor shall afford every facility for and every assistance in or in obtaining the right to such access.

8.8 Inspection of works: i) No work shall be covered up or put out of view without the approval of the Engineer In charge or the Engineer In charge-in-charge's representative or any other officer nominated by the company for the purpose and the contractor shall afford full opportunity for the EIC or EIC's representative or any other officer nominated by the company for the purpose to examine and measure any work which is about to be covered up or put out of view and to examine foundations before permanent work is placed thereon, the contractor shall give due notice to the Engineer In charge-in-charge's representative whenever any such work or foundations is ready or about to be ready for examination and the Engineer In charge-in-charge's representative shall, without unreasonable delay, unless he considers it unnecessary and advises the contractor accordingly, attend for the purpose of examining and measuring such work or foundations.

ii) The contractor shall uncover any part or parts of the works or making openings in or through the same as the Engineer In charge may from time to time direct and shall reinstate and make good such part or parts to the satisfaction of Engineer In charge.

If any such part or parts have been covered up or put out of view after compliance with the requirement of sub-clause above and are found to be executed in accordance with the contract, the expenses of uncovering, making openings in or through and making good the same shall be borne by the Employer, but in any other cases all costs shall be borne by the contractor.

8.9 Removal of Improper Work and Materials:

i) The Engineer In charge shall during the progress of the works have power to order in writing from time to time:

a) The removal from the site, of any materials which in the opinion of Engineer In charge, are not in accordance with the contract/ work order/ approved sample.

b) The substitution with proper and suitable materials.

c) The removal and proper re-execution, notwithstanding any previous test thereof or interim payment therefore, of any work which in respect of materials or workmanship is not in accordance with the contract.

ii) In case of default on the part of the contractor in carrying out such order, the Engineer In charge shall be entitled to employ and pay other agency to carry out the same and all expenses consequent thereon shall be recoverable from the contractor or may be deducted from any amount due or which may become due to the contractor.

8.10 Devaluation of Work :

In lieu of rejecting work done or materials supplied not in conformity with the contract/work order/approved samples, the Engineer In charge or any other officer nominated by the company for the purpose may allow such work or materials to remain, provided the Engineer In charge / the officer nominated by the company is satisfied with the quality of any materials, or the strength and structural safety of the work, and in that case shall make such deduction for the difference in value, as in his opinion may be reasonable.

8.11 Final Inspection of Work : The Engineer In charge and any other officer nominated by the company for the purpose shall make final inspection of all work included in the contract/work order, or any portion thereof, or any completed structure forming part of the work of the contract, as soon as practicable after notification by the contractor that the work is completed and ready for acceptance. If the work is not acceptable to the Engineer In charge at the time of such inspection, he shall inform the contractor in writing as to the particular defects to be remedied before final acceptance can be made.

8.12 Defects appearing after acceptance : Any defects which may appear within the defect liability period and arising, in the opinion of the Engineer In charge, from lack of conformance with the drgs. and specifications, shall, if so required by the Engineer In charge in writing, be remedied by the contractor at his own cost within the time stipulated by the Engineer In charge. If the contractor fails to comply, the Engineer In charge may employ other persons to remedy the defects and recover the cost thereof from the dues of the contractor.

8.13 Site Order Book : A Site Order Book is a Register duly certified by the Engineer In charge-in-charge regarding number of pages it contains, each page being numbered, name of work, name of contractor, reference of contract/ work order and the aforesaid certificate should be recorded on its first page.

Site Order Books shall be maintained on the sites of works and should never be removed there from under any circumstances. It shall be the property of the company. The Engineer In charge or his authorised representative shall duly record his observations regarding any work which needs action on the part of the contractor like, improvement in the quality of work, failure to adhere to the scheduled programme etc. as per contract/work order. The contractor shall promptly sign the site order book and note the orders given therein by the EIC or his representative and comply with them. The compliance shall be reported by the contractor in writing to EIC in time so that it can be checked.

The Site Order Book will be consulted by the Engineer In charge at the time of making both running on account and final bills of the contractor. A certificate to this effect should be given in the Measurement books by the Engineer In charge or his representative.

8.14 Samples and Testing of Materials: All the materials to be procured by the contractor and to be used in work shall be approved by the Engineer In charge in advance, and shall pass the tests and analysis required by him, which will be as specified in the specifications of the items concerned and or as specified by BIS or the IRC standard specifications acceptable to the Engineer In charge . The method of sampling and testing shall be as per the relevant BIS, IRC and other

relevant standards and practices. Minor minerals like sand, stone chips etc. shall be conforming to relevant BIS standards. All bought out items including Cement and Steel shall be procured from such manufacturers who hold valid license conforming to relevant BIS standards for manufacturing of such items.

8.15 Storage of Materials : Materials shall be so stored as to ensure the preservation of the quality and fitness for the work. When considered necessary by the Engineer In charge, they shall be placed on wooden platforms or other hard, clean surfaces and not directly on the ground.

Materials shall be placed under cover when so directed and the contractor shall erect and maintain at his own cost temporary weather-proof sheds at the work site for the purpose. Stored materials shall be so located as to facilitate prompt inspection. All stored materials shall be inspected at the time of use in the work, even though they may have been inspected and approved before being placed in storage or during storage.

8.16 Defective Materials : All materials not conforming to the requirements of the specifications shall be considered as defective, and all such materials, whether in place or not shall be rejected. They shall be removed immediately by the contractor at his expenses and replaced with acceptable material.

No rejected material, the defects of which have been subsequently corrected, shall be used on the work until approval in writing has been given by the Engineer In charge. Upon failure on the part of the contractor to comply with any instruction of the Engineer In charge-in-charge made under the provisions of this article within the time stipulated by the Engineer In charge, the Engineer In charge shall have authority to remove and replace defective material and recover the cost of removal and replacement from the contractor.

Further all such defective material lying at site not removed and replaced within 30 days after issue of notice by the Engineer In charge, if the Engineer In charge so decides, shall dispose off such material in any manner without any further written notice to the contractor.

9. Measurement and Payments

Except where any general or detailed description of the work in the Bill of Quantities or specifications of the contract/ work order provides otherwise, measurement of work done shall be taken in accordance with the relevant standard method of measurement published by the Bureau of Indian Standards(BIS) and if not covered by the above, other relevant Standards/practices shall be followed as per instructions of the Engineer In charge .

9.1 All items of work carried out by the contractor in accordance with the provision of the contract having a financial value shall be entered in the Measurement Book as prescribed by the company so that a complete record of the measurements is available for all the works executed under the contract and the value of the work executed can be ascertained and determined therefrom. Measurements of only completed work/ portion of work shall be recorded in the Measurement Books.

9.2 Measurement shall be taken jointly by the Engineer In charge or his authorised representative and by the contractor or his authorised representative.

9.3 Before taking measurements of any work, the Engineer In charge or the person deputed by him for the purpose shall intimate the contractor to attend or to send his representative to attend the measurement. Every measurement thus taken shall be signed and dated by both the parties on the site on completion of the measurement. If the contractor objects to any measurements, a note to that effect shall be made in the Measurement Book / Log Book and signed and dated by both the parties.

9.4 The measurement of the portion of work/items of work objected to, shall be re-measured by the Engineer In charge himself or the authority nominated by the company for the purpose in the presence of the contractor or his authorised representative and recorded in the M.B which shall be signed and dated by both the parties. Measurements so recorded shall be final and binding upon the contractor and no claim whatsoever shall thereafter be entertained.

In case the contractor or his authorised representative does not attend to the joint measurements at the prefixed date and time after due notice, the measurements taken by the Engineer In charge or his representative shall be final and binding on the contractor.

Measurement of the extra items of work or excess quantities of work duly authorised in writing by the Engineer In charge shall also be taken and recorded in the M.B. based on the existing items in the SOR of the company and if such items do not exist in the company's SOR, the description of the work shall be as per actual execution. Payment for such extra items will be based on the rates to be derived as described in the relevant clauses of the contract agreement/ work order.

9.5 No work shall be covered up or put out of view without the approval by the Engineer In charge and recording of measurements and check measurement thereof duly accepted by the contractor. The contractor shall provide full opportunity to the Engineer In charge or his representative to examine and measure all works to be covered up and to examine the foundations before covering up.

The contractor shall also give notice to Engineer In charge whenever such works or foundations are ready for examination and the Engineer In charge shall without unreasonable delay arrange to inspect and to record the measurements, if the work is acceptable and advise the contractor regarding covering of such works or foundations.

9.6 In case of items which are claimed by the contractor but are not admissible according to the department, measurements of such items, will be taken by for record purposes only and without prejudice so that in case it is subsequently decided by the department to admit the contractor's claims, there should be no difficulty in determining the quantities of such work. A suitable remark should, however, be made against such measurements to guard against payment in the ordinary way.

9.7 Payments : The running on account payments may be made once in a month or at intervals stipulated in the work order/ contract agreement.

9.7.01 Running on account bill/bills for the work executed/ materials supplied in accordance with the work order/ contract shall be prepared on the basis of detailed measurements recorded as described herein before and processed for payments.

9.7.02 Payment of on account bill shall be made on the Engineer In charge 's certifying the sum to which the contractor is considered entitled by way of interim payment for the following :

a) The work executed as covered by the bill/bills after deducting the amount already paid, the security deposit and such other amounts as may be deductible or recoverable in terms of the work order/ contract.

b)(i) Payment for excess quantity of work done with the written instructions of the Engineer In charge for items already appearing in the bill of quantities of work with approved rates, will be made alongwith the on account bills only upto 10% of the quantity provided in the agreement subject to overall value of work not exceeding the agreement value.

b) (ii)The CGM(E&M)/GM(E&M)/CE(E&M) of the company and/or the Staff Officer (E&M) of the Area may authorise interim payment for excess work done upto 20% of the quantity of work provided in the Bill of Quantity of the work awarded from Company level & Area level respectively subject to overall value of work done does not exceed the contract value.

c) Extra items of work executed will be paid on specific written authorisation of CGM(E&M) / GM(E&M) /CE(E&M) of the company or Staff Officer(E&M) of the Area provided that the value of such extra items of work when added together is not more than 10% of the contract value and the total gross payment including excess quantity does not exceed the contract value.

Balance amount on account of excess quantity and extra items of work executed shall be paid after the deviation estimate / revised estimate regularising the extra items and excess quantities of work is sanctioned by the competent authority of the company with the concurrence of the Finance Department.

d) On the Engineer In charge 's certificate of completion in respect of the work covered by the contract/ final measurements of the work certified by the Engineer In charge or his representative.

9.7.03 The measurements shall be entered in the M.B for the work done upto the date of completion and evaluated based on the approved rates for the items in the contract agreement/sanctioned revised estimate. In case of extra items of work, the rates shall be derived as stated in the relevant clause of the contract.

The payments shall be released against the final bill subject to all deductions which may be made on account of materials supplied, water supply for construction, supply of electricity and any other dues payable by the contractor to the company, and further subject to the contractor having given to the Engineer In charge no claim certificate. The contractor shall indemnify the company against proof of depositing royalty on account of minor minerals used in the work before the final bill is processed for payments. The final payment to be made will also be subject to clause-4.5 of the General Terms & Conditions of the contract.

9.7.04 Any certificate given by the Engineer In charge for the purpose of payment of interim bill/bills shall not of itself be conclusive evidence that any work/materials to which it relate is/are in accordance with the contract and may be modified or corrected by the Engineer In charge by any subsequent certificate or by the final certificate.

9.7.05 The company reserve the right to recover/enforce recovery of any over payments detected after the payment as a result of post payment audit or technical examination or by any other means, notwithstanding the fact that the amount of disputed claims, if any, of the contractor exceeds the amount of such overpayment and irrespective of the facts whether such disputed claims of the contractor are the subject matter of arbitration or not.

The amount of such over payments shall be recovered from subsequent bills under the contract, failing that from contractor's claim under any other contract with the company or form the contractor's security deposit or the contractor shall pay the amount of over payment on demand. In case of contractor's non-payment on such demand, the same should be realised from the contractor's dues, if any, with Coal India Limited or any of its subsidiaries.

9.7.06 The contractors are required to execute all works satisfactorily and according to the specifications laid down in the contract/ work order. If certain items of work, executed by the contractor, are below specifications, the contractor should redo them according to the specifications and instructions of EIC and if the contractor fails to rectify the defect within the time and in the manner specified by the EIC, the work shall be got re-done or rectified by the department at the risk and cost of the contractor. Engineer In charge may accept such work of below specifications provided the department is satisfied with the quality of such works and the strength/ structural safety of such works. In that case Engineer In charge shall make such deductions for the difference in value, as in his opinion is reasonable and is approved by the accepting authority of the company i.e. (CGM(E&M)/ GM(E&M)/CE(E&M) of the company or any other officer nominated by CGM(E&M)/ GM(E&M)/CE(E&M) for the purpose.

9.7.07 Payment Stage : The payment stage involved will be as under:

i) Signature of S O E(E&M) in MB's both in pages recording measurements, abstract of bill and the duly filled in bill form.

ii) Signature of Engineer In charge(E&M)/EE(E&M)with appropriate check measurements in the MBs and the bill form.

iii) Signature of Sr.EE(E&M)/SE(E&M)with appropriate check measurements in the MBs and the bill form.

iv) Signature of Engineer In charge In Charge as per definition as at clause 1

(vii) of the General Terms and Conditions, as a token of acceptance for payment of the bill. The EIC may sign in the abstract of the bill in the MB & the bill form. In between stage iii) and iv) accountal checking may be made by the concerned Accounts Officer/Accountant.

9.7.08 : Deleted:

9.8 Income tax deduction @ 2% of the gross value of each bill or at the rate as amended from time to time, shall be made unless exempted by the competent authority of the Income Tax Department.

Sales tax on works contract shall be payable by the contractor. If, however, the company is asked to make deduction from the contractor's bills, the same shall be done and a certificate to this effect shall be issued to the contractor for dealing with the State Govt. and the company does not take any responsibility to do anything further in this regard.

9.9 No interest shall be payable on the amounts withheld, under the terms of the Agreement/Work-order .

10. Termination, Suspension, Cancellation and Foreclosure of Contract

The company shall, in addition to other remedial steps to be taken as provided in the conditions of contract be entitled to cancel the contract in full or in part, if the contractor :-

a) makes default in proceeding with the works with due diligence and continues to do so even after a notice in writing from the Engineer In charge , then on the expiry of the period as specified in the notice.

Or

b) commits default/breach in complying with any of the terms and conditions of the contract and does not remedy it or fails to take effective steps for the remedy to the satisfaction of the Engineer In charge , then on the expiry of the period as may be specified by the Engineer In charge in a notice in writing.

Or

c) obtains a contract with the company as a result of ring tendering or other non-bonafide methods of competitive tendering.

Or

d) shall offer or give or agree to give any person in the service of the company or to any other person on his behalf any gift or consideration of any kind as an inducement or reward for act/acts of favour in relation to the obtaining or execution of this or any other contract for his company.

Or

e) fails to complete the work or items of work with individual dates of completion, on or before the date/dates of completion or as extended by the company, then on the expiry of the period as may be specified by the Engineer In charge in a notice in writing.

Or

f) transfers, sublets, assigns the entire work or any portion thereof without the prior approval in writing from the Engineer In charge . The Engineer In charge may by giving a written notice, cancel the whole contract or portion of it in default.

10.1 The contract shall also stand terminated under any of the following circumstances :

a) If the contractor being an individual in the case of proprietary concern or in the case of a partnership firm any of its partners is declared insolvent under the provisions of Insolvency Act for the time being in force, or makes any conveyance or assignment of his effects or composition or arrangement for the benefit of his creditors amounting to proceedings for liquidation or composition under any Insolvency Act.

b) In the case of the contractor being a company, its affairs are under liquidation either by a resolution passed by the contractor's company or by an order of court, not being a voluntary liquidation proceedings for the purpose of amalgamation or reorganisation, or a receiver or manager is appointed by the court on the application by the debenture holders of the contractor's company, if any

c) If the contractor shall suffer an execution being levied on his/their goods, estates and allow it to be continued for a period of 21 (twenty one) days.

d) On the death of the contractor being a proprietary concern or of any of the partners in the case of a partnership concern and the company is not satisfied that the legal representative of the deceased proprietor or the other surviving partners of the partnership concern are capable of carrying out and completing the contract. The decision of the company in this respect shall be final and binding which is to be intimated in writing to the legal representative or to the partnership concern.

10.2 On cancellation of the contract or on termination of the contract, the Engineer In charge shall have powers :

a) to take possession of the site and any materials, constructional plant, equipments, stores etc thereon

b) to carry out the incomplete work by any means at the risk and cost of the contractor

c) to determine the amount to be recovered from the contractor for completing the remaining work or in the event the remaining work is not to be completed the loss/damage suffered, if any, by the company after giving credit for the value of the work executed by the contractor upto the time of cancellation less on a/c payments made till date and value of contractor's materials, plant, equipment, etc. taken possession of after cancellation.

d) to recover the amount determined as above, if any, from any money due to the contractor on any account or under any other contract and in the event of any shortfall, the contractor shall be called upon to pay the same on demand. The need for

determination of the amount of recovery of any extra cost/expenditure or of any loss/damage suffered by the company shall not however arise in the case of termination of the contract for death/demise of the contractor as stated in 10.1(d) of the contract.

e) to give the contractor or his representative on the work 7 days notice in writing for taking final measurement for the works executed till the date of cancellation or termination of the contract. The Engineer In charge shall fix the time for taking such final measurement and intimate the contractor in writing. The final measurement shall be carried out at the said appointed time notwithstanding whether the contractor is present or not. Any claims as regards measurement which the contractor is to make shall be made in writing within 7 (seven) days of taking final measurement by Engineer In charge-In-charge as aforesaid and if no such claim is received, the contractor shall be deemed to have waived all claims regarding above measurements and any claim made thereafter shall not be entertained.

10.3 Suspension of Work:

i) The company shall have power to suspend the work or any part thereof and the Engineer In charge may direct the contractor in writing to suspend the work, for such period and in such manner as may be specified therein, on account of any default on the part of the contractor, or for proper execution of the work for reasons other than any default on the part of the contractor, or on ground of safety of the work .

ii) In the event of suspension for reasons other than any default on the part of the contractor, extension of time shall be allowed by the company equal to the period of such suspension and the contractor shall properly protect and secure the works to the extent necessary during such suspension.

The contractor shall carry out the instructions given in this respect by the Engineer In charge & if such suspension exceeds 45 (forty five) days, the contractor will be compensated on mutually agreed terms.

10.4 The work shall, throughout the stipulated period of contract, be carried out with all due diligence on the part of the contractor. In the event of termination or suspension of the contract, on account of default on the part of the contractor, as herein before narrated, the security deposit and other dues of this work or any other work done under this company shall be forfeited and brought under the absolute disposal of the company provided, that the amount so forfeited shall not exceed 10(ten) percent of the contract value.

10.5 Foreclosure of contract:

If at any time after acceptance of the tender the company decides to abandon for any reason whatsoever, the company through its Engineer In charge , shall give notice in writing to that effect to the contractor. In the event of abandonment the company shall be liable -

a) to pay reasonable amount assessed and certified by the Engineer In charge of the expenditure incurred, if any, by the contractor on preliminary works at site e.g. temporary access roads, temporary construction for labour and staff quarters, office accommodation, storage of materials, water storage tanks and water supply for the work including supply to labour/staff quarters, office etc.

b) to pay the contractor at the contract rates full amount for works executed and measured at site upto the date of such abandonment.

c) to pay for the materials brought to site or to be delivered at site, which the contractor is legally liable to pay, for the purpose of consumption in works carried out or were to be carried out but for the foreclosure, including the cost of purchase and transportation and cost of delivery of such materials. The materials to be taken over by the company should be in good condition and the company may allow at its discretion the contractor to retain the materials in full or in part if so desired by him and to be transported by the contractor from site to his place at his own cost with due permission of the Engineer In charge .

d) to take back the materials issued by the company but remaining unused, if any, in the work on the date of abandonment/reduction in the work, at the original issue price less allowance for any deterioration or damage caused while in custody of the contractor.

e) to pay for the transportation of tools and plants of the contractor from site to contractor's place or to any other destination, whichever is less.

10.5.01 The contractor shall, if required by the Engineer In charge , furnish to him books of accounts, papers, relevant documents as may be necessary to enable the Engineer In charge to assess the amounts payable in terms of para 10.5(b) (E&M) & (e) of the contract. The contractor shall not have any claim for compensation for abandonment of the work, other than those as specified above.

11. Completion Certificate

Except in cases where the contract provides for 'Performance Test' before issue of completion certificate, in which case the issue of completion certificate shall be in accordance with the procedure specified therein, the contractor shall give notice of completion of work, as soon as the work is completed, to the Engineer In charge . The Engineer In charge and or any other Officer, nominated for the purpose by the company, shall within 30 (thirty) days from the receipt thereof ,inspect the work and ascertain the defects/deficiencies, if any, to be rectified by the contractor as also the items, if any, for which payment shall be made at reduced rate.

If the defects, according to the Engineer In charge are of a major nature and the rectification of which is necessary for the satisfactory performance of the contract, he shall intimate in writing the defects and instruct the contractor to rectify the defects/remove deficiencies within the period and in the manner to be specified therein. In such cases completion certificate

will be issued by the Engineer In charge after the above rectifications are carried out/ deficiencies are removed by the contractor to the satisfaction of Engineer In charge .

In the event there are no defects or the defects/deficiencies are of a minor nature and the Engineer In charge is satisfied that the contractor has already made arrangements for rectification, or in the event of contractor's failure to rectify the defects for any reason whatsoever, the defects can be rectified by the company departmentally or by other means and the 50% of the security deposit of the contractor shall be sufficient to cover the cost thereof, he shall issue the completion certificate indicating the date of completion of the work, defects to be rectified, if any, and the items, if any, for which payment shall be made at reduced rate indicating reasons therefore and with necessary instructions to the contractor to clear the site/place of work or all debris/ waste materials, scaffoldings, sheds, surplus materials etc. making it clean.

11.1 In cases where separate period of completion for certain items or groups of items are specified in the contract, separate completion certificate for such items or groups of items may be issued by the Engineer In charge after completion of such items on receipt of notice from the contractor only in the event the work is completed satisfactorily in every respect.

Refund of security deposit and payment of final bill shall, however, be made on completion of the entire contract work, but not on completion of such items of work.

12. Additional Responsibilities of the Contractor(s)

The cost on account of the 'Additional Responsibilities of the Contractors' under this clause is deemed to be included in the tendered rates.'

i) The company reserves the right to let other contractors also work in connection with the Project & the contractor/contractors shall co-operate in the works for the introduction and stores and materials and execution of his/their works.

ii) The contractor/contractors shall keep on the work site during the progress a competent and experienced Resident Engineer In charge exclusively for the work and necessary assistants who shall represent the contractor(s). The contractor shall employ, on the site in connection with the execution and maintenance of the work, the following technical staff :

For Buildings, Roads, Water Supply & Sanitary Works :

1) For value of work ranging from Rs.10 lakhs to 20 lakhs	1 Experienced Diploma holder.
2) For value of work above Rs.20 lakhs and upto Rs.1 crore	1 Experienced Graduate Engineer In charge in addition to Diploma holder as per sl.no.4 below.
3) For value of work in excess of Rs.1 crore & for every additional 2 crores or part thereof	1 Graduate Engineer In charge extra in addition to Graduate Engineer In charge and Diploma holder as per sl. no. 1 & 4
4) For value of work in excess of Rs.20 lakhs & for every additional Rs.50 lakhs or part thereof	1 Diploma holder extra.

For Industrial Structures :

1) For value of work ranging from 5 lakhs to Rs.15 lakhs	1 Experienced Diploma holder.
2) For value of work over Rs.15 lakhs and upto Rs.75 lakhs	1 Experienced Graduate Engineer In charge in addition to Diploma holder as sl.no.4 below.
3) For value of work in excess of Rs.75 lakhs & for every additional Rs.1.5 crores or part thereof	1 Graduate Engineer In charge extra in addition to Graduate Engineer In charge and Diploma holder as per sl.no.1 & 4.
4) For value in excess of Rs.15 lakhs & for every additional Rs.50 lakhs value or part thereof.	1 Diploma holder extra.

The contractor shall intimate the Engineer In charge in writing the names, qualifications, experience and full postal address of the each and every technical personnel employed at site by him. The contractor(s) shall not be allowed to execute the work unless he/they engage the required technical staff at site as stated above. The delay on this account, if any, shall be the contractor's responsibility.

Important instructions shall be confirmed to the contractor(s) in writing. If the contractor/contractors in course of the works finds/find any discrepancy between the drawing, forming part of the contract documents and the physical conditions of the locality or any errors or omissions in drawings except those prepared by himself/themselves and not approved by the Engineer In charge . It shall be his/their duty to immediately inform the Engineer In charge in writing and the Engineer In charge shall verify the same. Any work done after such discovery and without intimation as indicated above will be done at the risk of the contractor/contractors.

iii) The contractor / contractors shall employ only competent, skillful and orderly men to do the work. The Engineer In charge shall have the right to ask the contractor/contractors to remove from the work site any men of the contractor/contractors who in his opinion is undesirable and the contractor/contractors will have to remove him within 3 (three) hours of such orders.

The contractor shall employ apprentices in the execution of the contract work as required under Apprentices Act.

The contractor shall further be responsible for making arrangements at his own cost, for accommodation and social needs of the staff and workers under his employment.

iv) Precautions shall be exercised at all times by the contractor(s) for the protection of persons (including employees) and property. The safety required or recommended by all applicable laws, codes, statutes and regulations shall be observed by the contractor(s).In case of accidents, the contractor(s) shall be responsible for compliance with all the requirements imposed by the Workmen's Compensation Act or any other similar laws in force, and the contractor(s) shall indemnify the company against any claim on this account.

All scaffoldings, ladders and such other structures which the workmen are likely to use shall be examined by the Engineer In charge or his authorised representative whenever they want and the structure must be strong, durable, and safe and of such design as required by Engineer In charge .

In no case any structure condemned by the Engineer In charge or his authorised representatives shall be kept on the work and such structure must be pulled down within three hours of such condemnation and any certificate or instructions, however, shall in no way absolve the contractor/contractors from his/their responsibility, as an employer, as the company shall in no way be responsible for any claim.

The contractor/ contractors shall at all times exercises reasonable precautions for the safety of employees in the performance of his/ their contract and shall comply with all applicable provisions of the safety laws drawn up by the State Govt. or Central Government or Municipalities and other authorities in India. The contractor/contractors shall comply with the provision of the safety hand book as approved and amended from time to time by the Government of India.

v) The contractor/ contractors shall familiarise themselves with and be governed by all laws and rules of India and Local statutes and orders and regulations applicable to his/their work.

vi) The contractor shall maintain all records as per the provision made in the various statutes including Contract Labour (Regulation & Abolition) Act, 1970 and the Contract Labour (Regulation & Abolition) Central Rules, 1971, Minimum wages Act, Workmen Compensation Act etc. and latest amendment thereof. Such records maintained by the contractor shall be opened for inspection by the Engineer In charge or by the nominated representative of the Principal Employer.

vii) The contractor/ contractors shall provide facilities for the sanitary necessities of all persons employed on the work shall be constructed and maintained in the number, manner and place approved or ordered by the Engineer In charge . The contractor/contractors shall vigorously prohibit committing of nuisance at any other place. Cost of all works under this item shall be covered by the contractor/contractor's tendered rates.

viii)The contractor / contractors shall furnish to the Engineer In charge or his authorised representative with work reports from time to time regarding the contractor/ contractors organisation and the progress made by him/ them in the execution of the work as per the contract.

ix) All taxes, whether Local, Municipal, Provincial or Central etc. and cess, royalties etc. are payable or may become payable during the entire periods of contract, shall be to the contractor/contractors account and shall be deemed to have been included in the tender for the work to be executed by him/them.

However in the event of any changes in Sales Tax on Works Contract as required by the Statutory Authority during the contract period necessary adjustments will be made in contractual payments. For this purpose, the base date shall be the date on which the price bids/revised price bids have been opened.

Amount payable/repayable for any subsequent change in the Sales Tax on Works Contract will be made to/from the contractors for departmental verification of such changes of tax law issued by the statutory authority.

In case the company land is used for manufacture of bricks or extraction of gravels etc. the contractor will have to pay compensation to the company (apart from the liability of the contractor to make the payment of royalty etc. to the State Government) at the same rates or royalty fixed by the State Government or an appropriate deduction may be made in the rate to be paid to the contractors.

x) The contractor / contractors shall make his / their own arrangement for all materials, tools, staff and labourer required for the contract, which shall include cost of lead, lift, loading, unloading, railway freight, recruiting expenses and any other charges for the completion of the work to entire satisfaction of the company.

xi)The contractor / contractors shall make their own arrangement for carriage of all materials to the work site at his/their own cost.

xii) The work shall not be sublet to any other party, unless approved by Engineer In charge , in writing.

xiii) a) No fruit trees or valuable plants or trees with trunk diameter exceeding 150mm shall be pulled, destroyed or damaged by the contractor/contractors or any of his/their employees without the prior permission of the company, failing which the cost of such trees or plants shall be deducted from the contractor/contractors dues at the rate to be decided by the company. The rates quoted are supposed to include clearance of shrubs and jungles and removal of such trees up to 150mm dia., as will be permitted by the Engineer In charge in writing.

b) Anything of historical or other interest or of significant value unexpectedly discovered on the site is the property of the employer. The Contractor is to notify the Nodal Officer or his nominee of such discoveries and carry out the Nodal Officer or his nominee's instructions for dealing with him.

xiv) The contractor / contractors shall not pay less than the minimum wages to the labourers engaged by him/them as per Minimum Wages Act or such other legislation or award of the minimum wage fixed by the respective State Govt. or Central Govt. as may be in force.

xv) All accounts shall be maintained properly and the company shall have the right of access and inspection of all such books of accounts etc., relating to payment of labourer considered necessary and the company may arrange for witnessing the payment to the labourer by its representatives.

xvi) The contractor shall in additions to any indemnity provided by the relevant clauses of the agreement or by law, indemnify and keep indemnified for the following :

a) The company or any agent or employee of the company against any action, claim or proceeding relating to infringement or use of any patent or design right and shall pay any royalties or other charges which may be payable in respect of any article or material included in the contract.

However, the amount so paid shall be reimbursed by the company in the event such infringement has taken place in complying with the specific directions issued by the company or the use of such article or material was the result of any drawing and/or specifications issued by the company after submission of tender by the contractor. The contractor must notify immediately after any claim being made or any action brought against the company, or any agent or employee of the company in respect of any such matter.

b) The company against all claims , damages or compensation under the provisions of payment of Wages Act, 1938, Minimum Wages Act, 1948, Employer's Liability Act, 1938, The Workmen's Compensation Act, 1923, Industrial Dispute Act, 1947, Mines Act as applicable, Employees State Insurance Act 1948 and Maternity Benefit Act, 1961. Acts regulating P.F. or any modification thereof or any other law relating thereto and rules made there under from time to time, as may be applicable to the contract which may arise out of or in consequence of the construction or maintenance or performance of the work under the contract and also against costs, charges and expenses of any suit, action or proceedings arising out of any accident or injury.

c) The company against all losses and claims for injuries or damages to any third party or to any property belonging to any third party which may arise out of or in consequence of the construction or maintenance or performance of the work under the contract and against all claims/demands proceedings/damages, cost charges and expenses whatsoever in respect of or in relation thereto.

xvii) The contractor is under obligation to hand over to the company the vacant possession of the completed building/structures failing which the Engineer In charge can impose a levy upon the contractor upto 5% of the total contract value for the delay in handing over the vacant possession of the completed works after giving a 15 (fifteen) days notice to the contractor.

xix) **Setting Out:** The contractor shall be responsible for the contract and proper setting out of the works and correctness of the position, reduced levels, dimensions and alignment of all parts of the work including marking out the correct lay out in reference to the permanent bench mark and reference points. Only one permanent bench mark and basic reference lines shall be marked and shown to the contractor as basic data.

The contractor shall have all necessary instruments, appliances and labour in connection therewith. If at any time during the progress of work any error is detected in respect of the position, levels, dimensions or alignment of any part of the work, the contractor on being required to do so by the Engineer In charge or his representative shall at the expenses of the contractor rectify such errors to the satisfaction of Engineer In charge unless such error is due to incorrect data supplied by the Engineer In charge .

xx) On receipt of Letter of Acceptance of Tender / Work Order the contractor shall forthwith Register and obtain License from the competent authority under the Contract Labour (Regulation & Abolition)Act 1970, the Contract Labour (Regulation & Abolition) Central Rules, 1971 and submit certified copies of the same to the Engineer In charge and the Principal Employer.

xxi) The contractor shall be registered with the concerned State Govt. and the Central Govt. in respect of Sales Tax Act and the certificate having details of Registration No., period of validity etc. should be submitted to the Engineer In charge .

xxii) The contractor shall, in connection with works, provide and maintain, at his own cost, all lights, security guards, fencing when and where necessary as required by the Engineer In charge for the purpose of protection of the works, materials at site, safety of workmen and convenience of the public.

xxiii) All materials (e.g. stone, moorum and other materials) obtained in the course of execution of the work during excavation and dismantling etc. shall be the property of the company and the same may be issued to the contractors, if required for use in the works at the rates to be fixed by the Engineer In charge .

xxiv) Unless otherwise specifically provided for, dewatering of excavation pits, working areas etc. shall be the contractor's responsibility and is to be carried out at his own cost as per instructions of EIC. The rates quoted by the contractor shall be deemed to include the dewatering costs.

xxv) Approval by the Nodal Officer/ Engineer In charge in Charge or his nominee. The contractor shall submit specifications and drawings showing the proposed temporary works to the Nodal Officer/ Engineer In charge-in-Charge or his nominee, who is to approve them if they comply with the specifications and drawings.

The contractor shall be responsible for design of Temporary Works.

The Nodal Officer/ Engineer In charge-in-Charge or his nominee's approval shall not alter the contractor's responsibility for design of the Temporary Works.

13. Defects Liability Period :

In addition to the defect/s to be rectified by the contractor as per terms of the contract / work order, the contractor shall be responsible to make good and remedy at his own expense the defect/s mentioned hereunder within such period as may be stipulated by the Engineer In charge in writing :

a) Any defect/s in the work detected by the Engineer In charge within a period of 6 (six) months from the date of issue of completion certificate.

b) In the case of building works or other works of similar nature any defect in the work detected by the Engineer In charge within a period of 6 (six) months from the date of issue of completion certificate or before the expiry of one full monsoon period i.e. June to October whichever is later in point of time.

13.1 A programme shall be drawn by the contractor and the Engineer In charge for carrying out the defects by the contractor detected within the defect liability period and if the contractor fails to adhere to this programme, the Engineer In charge shall be at liberty to procure proper materials and carry out the rectifications in any manner considered advisable under the circumstances and the cost of such procurement of materials and rectification work shall be chargeable to the contractor and recoverable from any of the pending dues of the contractors.

The defect liability period can be extended by the company on getting request from the contractor only for valid reasons.

14. Operating and Maintenance Manual:

If 'as built' drawing and/or operating and Maintenance Manual are required the contractor shall supply them by the dates as per instructions of the Engineer In charge .

If the contractor does not supply the drawings and/or Manual by the dates as stated above, or they do not receive the Nodal Officer of his nominee's approval, the Nodal Officer or his nominee shall withhold the amount as stated in the agreement.

15. Settlement of Disputes

15.1 It is incumbent upon the contractor to avoid litigation and disputes during the course of execution. However, if such disputes take place between the contractor and the department, effort shall be made first to settle the disputes at the company level. The contractor should make request in writing to the Engineer In charge for settlement of such disputes/claims within 30 (thirty) days of arising of the cause of dispute/claim failing which no disputes/claims of the contractor shall be entertained by the company.

15.2 If differences still persist, the settlement of the dispute with Govt. Agencies shall be dealt with as per the Guidelines issued by the Ministry of Finance, Govt. of India in this regard. In case of parties other than Govt. Agencies, the redressal of the dispute may be sought in the Court of Law.



CENTRAL MINE PLANNING & DESIGN INSTITUTE LIMITED
(A *Subsidiary of Coal India Ltd.*)
REGIONAL INSTITUTE-V,
SEEPAT ROAD,
BILASPUR – 495006

TENDER DOCUMENT(Part-II)

FOR

: **Electrical works (two points) power supply from 15 kVA DG set to hutments at Singhpur Exploration camp, Shahdol (MP) of CMPDI, RI-V Bilaspur.**

**CENTRAL MINE PLANNING & DESIGN INSTITUTE LTD
(A Subsidiary of Coal India Ltd)
Regional Institute – V
Seepat Road, Bilaspur – 495006**

Name of work : Electrical works (two points) power supply from 15 kVA DG set to hutments at Singhpur Exploration camp, Shahdol (MP) of CMPDI, RI-V Bilaspur.

Place of work : CMPDI, Exploration camp at Singhpur, Shahdol(MP)

Tender Notice No. & Date : CMPDI/RV/E&M/ Elect. Wiring/Singhpur/2015/3415 Dated 02.11.2015

Sale of Tender Document : From 04.11.2015 (4.00 PM) to 19.11.2015 till
1 .00 P.M

Date and time of submission of
tender : 19.11.2015 up to 3.00 PM

Date and time of opening of
Tender(part-II) : shall be communicated in due course after
consideration of part-I

Issued to :

Signature of Issuing Authority

**Price-Bid format for Electrical works for two points power supply from 15 kVA DG set (under installation)to hutments and office at
Singhpur Expl. Camp, Shahdol (MP) of CMPDI , RI-V Bilaspur (CG)**

Sl. No.	Ref No	Description	Unit	Qty.	Rate	Amount
1	DSR-2013/1.23.2	Supplying and fixing of 2 way 5/6 amps piano type switch on the existing switch box/ cover including connections etc. as required .	Each	76	37.00	2812.00
2	item code 9.1.33	Supplying and making end termination with brass compression gland and aluminium lugs for 4 x 16 sq. mm (28 mm) size of PVC insulated and PVC Sheathed/ XLPE aluminium conductor cable of 1.1 KV grade as required.	Each	40	208.00	8320.00
3	1.17.1	supplying and drawing 1 X 1.5 sq.mm sizes of FRLS PVC insulated copper conductor, single core cable in the existing surface / recessed steel/ PVC conduit as required.	Mtr.	900	21.00	18900.00
4	1.17.20	supplying and drawing 2 X 4 sq.mm sizes of FRLS PVC insulated copper conductor, single core cable in the existing surface / recessed steel/ PVC conduit as required.	Mtr.	100	79.00	7900.00
5	2.2.15	Providing and fixing of 200 Amp,36 KA, FPMCCB rating and breaking capacity and pole MCCB in existing cubicle panel board including drilling holes in cubical panel, making connections, etc. as required.	Each	1	10995.00	10995.00
6	1.21.1	Supplying and fixing of 20 mm size of medium class PVC conduit alongwith accessories in surface / recess including cutting the wall and making good the same in case of recessed conduit as required.	Metre	850	64.00	54400.00
7	Item code 1742	Sheet steel DP MCB Enclosure	Each	76	147.26	11191.76
8	SOR-2010/11.11.1	Supplying and fixing of 0.5 amps to 5 amps (1 amp required) SP MCB , 240 volts, 'C' series, suitable for inductive load in the existing MCB DB complete with connections, testing and commissioning etc. as required.	Each	76	203.00	15428.00
9	12.4.1	Providing and fixing metal clad ,4 pole, 63 Amps on load change over switch unit (with sheet steel enclosure), 415/500 V in cubicle panel including drilling holes on the board connects earthing the body , testing and commissioning etc. as required.(connecting lead if required shall be paid separately).	Each	1	5638.00	5638.00
10	17.1.23	Supplying and laying of 4 x 16 sq. mm size one number PVC insulated , PVC sheathed , steel armoured, aluminium conductor power cable of 1.1 KV grade direct in ground including excavation, sand cushioning, protective covering and refilling the trench etc as required.	Mtr	1100	225.00	247500.00
11	17.1.24	Supplying and laying of 4 x 25 sq. mm size one number PVC insulated , PVC sheathed , steel armoured, aluminium conductor power cable of 1.1 KV grade direct in ground including excavation, sand cushioning, protective covering and refilling the trench etc as required.	Mtr	185	256.00	47360.00
12	6.2.5	Supplying and fixing of 200mmx150mm wooden switch box made of wooden plank side wall and base including 3mm thick phenolic laminated sheet cover on surface complete as required.	Each	77	60.00	4620.00
13	21.15.1	Supplying and fixing water tight terminal box made of 1.6mm thick MS sheet with detachable gland plate in bottom hinged front openable cover rubber gasket having 2 Nos. 4 way connector and 1 No. SPMCB (5amp) inside the box for cable connection fixed to pole with 2 Nos. clamp made from 40x3 mm MS flat with 2 No. nut bolt dully painted with 2 coat of red oxide paint and 2 coat aluminium paint complete as required. (20x15x15 cms)	Each	20	614.00	12280.00
14	9.21	Fabrication, Supply, installation, testing and commissioning of cubicle type compartmentalized wall /floor mounted power cum control panel board of specified size and depth above 300 mm and upto 450mm made out of not less than 2 mm thick CRCA MS sheet with suitable size compartments for bus bars, switch gears and necessary cutouts for voltmeters, ammeters etc as per specifications including powder coating painting but without busbars, switchgears and other accessories etc. complete as required. (Only face area is to be measured)	sqm	1.25	6182.00	7743.57
Total						455088.33
Say						455089.00

Offered rate will be -----%-----
) in words above/ below or at par the estimated value. Note: (Rates are inclusive of all taxes but excluding Service Tax)

Signature of the bidder with seal